

# Guidelines for Complying with BPI's Technical Standards for the Air Conditioning and Heat Pump Professional

Version NV.1.02  
Adapted for Clark County, NV

September 23, 2010

Prepared for:

Building America Program  
US Department of Energy



## Foreword

This guide provides information on how to comply with BPI's Technical Standards for the Air Conditioning and Heat Pump Professional and is intended to compliment the Data Collection Forms provided in the Appendix. It is intended for both HVAC technicians and Third Party Verifiers. This guide follows the same numbering and order of BPI's standard as does the Data Collection Form. One form should be used for each HVAC system in the home. Where different, requirements of the "Home Performance Specifications for Warm Climates" (HPS) take precedence over the BPI requirements. These changes from BPI have been noted in the manual with the following symbol:



Information contained herein applies to residential buildings 3 stories or less in height.

Sample forms, equipment lists and checklists are located in the Appendix and are also available in electronic format

This work was originally compiled for the Clark County Community Resources Management Division in Las Vegas, NV. Examples and some requirements have been geared toward that climate.

**Written by:**      **Lois B. Arena**  
Steven Winter Associates, Inc.  
50 Washington Street  
Norwalk, CT 06854  
P: (203) 857-0200  
F: (203) 852-0741

## Acknowledgements

The authors would like to credit the U.S. Department of Energy's Building America initiative which funded much of this work. Thanks also to the following participants : Community Resources Management Division, Michael Pawlak Manager, Las Vegas, NV; Guy Wanegar, A&B Cooling & Heating Corp., South Windsor, CT.

## Disclaimer

This report was prepared as a result of work sponsored by the Building America program from the U.S. Department of Energy (DOE). It does not necessarily represent the views of the DOE, or its employees. The DOE and its employees make no warranty, expressed or implied, and assume no legal liability for the information in this report; nor does any party represent that the use of this information will not infringe upon privately owned rights. This report has not been approved or disapproved by the DOE nor has the DOE passed upon the accuracy or adequacy of the information in this report.

**TABLE OF CONTENTS**

**1 HEALTH & SAFETY ..... 1-1**

1.1 Personal ..... 1-1

1.2 Occupant ..... 1-2

1.3 Electrical ..... 1-3

1.4 Refrigerant ..... 1-5

**2 INSTALLATION ..... 2-1**

2.1 Design ..... 2-1

2.2 Airflow ..... 2-22

2.3 Duct Systems ..... 2-28

2.4 Refrigerant ..... 2-35

2.5 Controls ..... 2-42

2.6 Commissioning ..... 2-43

**3 COMMISSIONING ..... 3-1**

3.1 Airflow ..... 3-1

3.2 Commissioning ..... 3-3

**4 SERVICE & REPAIR ..... 4-1**

4.1 Duct Systems ..... 4-1

4.2 Refrigerant ..... 4-2

4.3 Airflow ..... 4-3

**5 DIAGNOSTIC TESTS ..... 5-1**

5.1 Electrical ..... 5-1

5.2 Airflow ..... 5-2

5.3 Duct Systems ..... 5-2

5.4 Refrigerant ..... 5-2

**REFERENCES**

**APPENDIX A. .... FIELD CHECKLISTS**

**APPENDIX B. .... AUDITOR’S EQUIPMENT LIST**

**APPENDIX C. .... ACCA BRIEFING ON MJ8™**

**APPENDIX D. .... REGISTER FLOW & ROOM-TO-ROOM PRESSURE FORM**

## Table of Figures

Figure 1 Manual J Whole House Load Calculation – Report from Right-Suite® Universal	2-3
Figure 2 Component Construction Summary for Manual J Calculations.....	2-4
Figure 3 AHRI Certificate of Product Ratings .....	2-6
Figure 4 AHRI Database - Search Page.....	2-8
Figure 5 AHRI Database – Search Results .....	2-9
Figure 6 AHRI Database – Heat Pump Selection.....	2-10
Figure 7 Climate Zones for LBL’s Air Leakage Factors.....	2-13
Figure 8 Manual J Room by Room Load Calculations .....	2-17
Figure 9 Sample Duct Design .....	2-18
Figure 10 Duct Design Details Based on Room by Room Load Calculations .....	2-19
Figure 11 Ceiling Register Data .....	2-20
Figure 12 Examples of Unsuitable Filter Slots.....	2-29
Figure 13 Tips for Sealing Flex Duct .....	2-31
Figure 14 Sealing Duct Boots & Connections.....	2-33
Figure 15 Capillary Tube Metering Device.....	2-36
Figure 16 TXV Metering Device.....	2-36
Figure 17 Pressure/Temperature Chart for R-410A and R-22 Refrigerants. ....	2-40

**Table of Tables**

Table 1 Tightness Categories Reproduced from Manual J, 8<sup>th</sup> Edition..... 2-12  
Table 2 LBL’s Factors for Climate Zones, # of Stories and Shielding..... 2-13

## Introduction

---

There are an increasing number of township, city, county, state, and national mandates on new construction and renovations to ensure energy efficiency. Many of those mandates include requirements to meet standards developed by the Building Performance Institute, Inc. (BPI) and to have third-party verifiers, like those certified by BPI and the Residential Energy Services Network (RESNET), to confirm compliance with those mandates.

These mandates are well intentioned, but many of the codes and standards are lacking comprehensive guidelines and explanations on how to actually comply with their requirements.

This field guide is intended to explain how HVAC contractors can actually achieve compliance with the Building Performance Institute, Inc.'s (BPI) "Technical Standards for the Air Conditioning and Heat Pump Professional". This BPI standard is intended to provide quality criteria which must be met by HVAC contractors when installing space cooling systems in new and existing homes. In addition, this field guide provides guidelines to third-party verifiers on confirming that HVAC contractors work is in compliance with the standard.

The "Technical Standards for the Air Conditioning and Heat Pump Professional" is available from BPI at no cost and can be downloaded from:  
[http://www.bpi.org/standards\\_approved.aspx](http://www.bpi.org/standards_approved.aspx).

## 1 Health & Safety

---

Items listed in the Health & Safety section of the BPI technical standards must be followed by the HVAC technician and the Third Party Verifier.

### 1.1 Personal

#### 1.1.1 All technicians performing diagnostic tests, inspections, or installations, must have access to all necessary personal safety equipment required by OSHA.

The following is a partial list of the kinds of protective equipment that technicians should have available to them when working on the job:

- A fitted cartridge-type NIOSH-certified respirator with appropriate cartridge suitable for the purpose intended
- Dust masks (to be used for quick inspections, or in situations where a respirator cannot be used)
- Safety glasses
- Work gloves
- Coveralls (disposable coveralls are best and should be discarded after each job)
- Kneepads

#### 1.1.2 Safety glasses and gloves must be worn when handling refrigerant or when brazing.

Only EPA-Approved Section 608 certified technicians may service small residential air conditioning or heat pump equipment.

#### 1.1.3 Technicians must be trained in proper use and applications of all personal safety devices and must adhere to OSHA regulations when on the job site.

The contact information for NV is as follows:

State of Nevada  
Department of Business and Industry  
Division of Industrial Relations  
Occupational Safety and Health Administration  
1300 N. Green Valley Parkway, Suite 200  
Henderson, NV 89074  
702 486 9064

Contact your local OSHA office for training and certification programs near you:  
<http://www.osha.gov/index.html>.

## 1.2 Occupant

- 1.2.1 The building occupants must be informed of the likelihood of airborne contaminants (asbestos, fiberglass, mold, etc.) in the home during and after inspection and improvement of airflow to the AC or heating system.

Some government programs require that homes are vacant during renovations. If occupants will be present, provide the appropriate notifications.

### 1.3 Electrical

#### 1.3.1 Electrical power must be shut off before working on mechanical equipment.

Anyone servicing the equipment should shut all equipment (condensing unit and air handler unit) off at the main breaker panel as well as by using the local disconnect switches.

During the blower door and duct blaster tests, the technician and/or auditor should shut the power off at the electrical panel, at the air handler and/or turn the system off at the thermostat to prevent the system from turning on during these tests. Turn the power back on before performing airflow tests. The system will need to be operational during the air flow test across the coil.

NOTE: When turning off mechanical equipment, it is a good idea to leave your car keys by the breaker so you don't forget to turn the equipment back on.

#### 1.3.2 Electrical wiring for HP/AC units must be in compliance with relevant codes. Improper connections, wire sizing and other problems identified must be corrected prior to proceeding to system diagnostics or repairs.

The HVAC technician is responsible for verifying that the wiring is compliant with the manufacturer's specifications and local codes. The auditor or third party verifier should confirm that this item is checked off on the Data Collection Form.

The technician should measure main components individually for voltage and amperage. For example, blower motors, compressors and control transformers have nameplate ratings and they should all be tested individually to make sure they are operating within the manufacturer's specified range.

According to the ACCA's "Technicians Guide for Quality Installations", the following practices should be observed for electrical verifications:

- "For electrical heating devices, the voltage and amperage should be tested with all the elements on. Electrical supply, main line sizes and disconnect ratings must be within ranges specified by the manufacturer.
- Low (control voltage) readings should be taken with a meter at the terminals on the low voltage side of the control transformer or at the control's terminal connection.
- High (line voltage) readings need to be checked at the main power equipment terminal or at the unit disconnect. If the equipment is three-phase, the voltage for all three line combinations must be read.
- Motor amperage readings must be taken on high speed if the system has variable speeds.

- Frequency drive amperage readings need to be checked at 60 HZ and should equal the frequency drive's digital read out within the accuracy of the test meter.
- Equipment voltages and amperages should be checked to ensure that they are within design limits of percentages specified by the manufacturer. Field voltage readings can be divided by name plate values and multiplied by 100 to determine percent of design. The final percentage must be within the original equipment manufacturers recommended range (usually +/- 10%)”.

The auditor should verify that the equipment operates in both cooling and heating mode and verify that the technician has checked this off on the data collection form.

## 1.4 Refrigerant

- 1.4.1 Refrigerant must be handled and stored in compliance with EPA Section 608 standards at all times, including charging, recovery, reclamation, storage, and transportation.

Only EPA certified technicians should be handling the refrigerant. Regulations have been issued under Section 608 of the Clean Air Act to minimize refrigerant emissions by maximizing the recovery and recycling of such substances during the service, repair, or disposal of refrigeration and air-conditioning equipment (i.e., appliances).

Information for technicians concerning proper handling is located at:

<http://www.epa.gov/Ozone/title6/608/608fact.html>.

- 1.4.2 Only EPA certified technicians may install or service small residential (smaller than 5 ton capacity) central air conditioning or heat pump equipment.

The technician's certification should be provided for the job file. Confirm that it has been provided.

Information for technicians including certification programs is located at:

<http://www.epa.gov/Ozone/title6/608/technicians/index.html>.

## 2 Installation

---

### 2.1 Design

- 2.1.1 Sizing for new and replacement central air conditioning and heat pump systems must be based on heating/cooling load calculations for the building using a recognized calculation method.

Residential systems should be sized in accordance with the most current version of ACCA Manual J (version 8 is the most current at the time of this publication) or the ASHRAE 2009 Handbook of Fundamentals<sup>1</sup>. There are several acceptable software packages, spreadsheets and calculation forms available. A few acceptable tools include (but are not limited to):

- Wrightsoft's Right-Suite: <http://www.wrightsoft.com>
- Elite Software's RHVAC: [http://www.elitesoft.com/web/hvacr/elite\\_rhvacw\\_info.html](http://www.elitesoft.com/web/hvacr/elite_rhvacw_info.html)
- Nitek Software's Load Wizard: <http://www.niteksoftware.com/web2008/product2008.html>
- Adtek Software's AccuLoad: <http://www.adteksoft.com/>

Following are examples of software that do NOT meet the requirements:

- HVAC Computer Systems' HVAC Calc 4.0 (7<sup>th</sup> edition of ACCA's Manual J)
- Trane's Trace 700 (commercial sizing tool)
- Carrier's HAP (commercial sizing tool)
- Elite Software's CHVAC (commercial sizing tool)
- Thomas & Associates' HEATLOSS version 3.2 (7<sup>th</sup> edition of ACCA's Manual J)

Commercial load calculation tools are not acceptable. There are major discrepancies between residential and commercial load calculations with relation to: (1) Ventilation Rates, (2) Infiltration Rates, (3) Lighting, and (4) Other latent and sensible internal gains.

Whichever tool is used, verify that it is based on the most current version of Manual J. The sample reports used in this manual were generated using Right-Suite® Universal from WrightSoft®.

The individual responsible for performing the Manual J calculations, whether it is the technician, designer or auditor, must provide a copy of the load calculation worksheets or software printout for the job file.

---

<sup>1</sup> The 99% heating and the 1% cooling design temperatures may be different in Table 1 of Manual J, 8<sup>th</sup> Edition and the 2009 ASHRAE Handbook of Fundamentals. Manual J, 8<sup>th</sup> edition uses data from the 2001 ASHRAE Handbook of

Before verifying that the system has been properly sized, the auditor/verifier will want to review several items in the HVAC designer's report including:

- Design indoor temperatures for both heating (70°F) and cooling (75°F);
- Design outdoor temperatures for both heating and cooling (30°F & 106°F respectively for Las Vegas, NV<sup>2</sup>);
- Infiltration rate assumed;
- Ventilation rate assumed;
- The edition of Manual J used, if applicable;
- The orientation of the home;
- Building component R-values, U-values and areas;
- Duct losses;
- # of people, appliances, or other internal gains
- Zones
- The total heating and cooling loads.

The sample reports in Figure 1 and Figure 2 provide examples of where to find these items on the reports. This information won't be in the same location for all software or spreadsheets, but all of the information must be verified.


The auditor should verify a few areas to check the designer's calculations. Conditioned square footage and window area by façade have the largest impact and are always good to verify. If these appear correct, move on. If not, perform a more thorough review of the building component R-values and areas.

NOTE: A briefing from the ACCA titled "Are You Using MJ8™ Correctly? Is included in the Appendix and can also be found here:  
<http://www.h5energy.com/AreYouUsingManualJ8Correctly.pdf>.

The sizing method used, the design loads and whether or not a copy of the load calculations has been provided should be indicated on the Data Collection Form.

---

<sup>2</sup> From Manual J, 8<sup>th</sup> Edition, Table 1A.

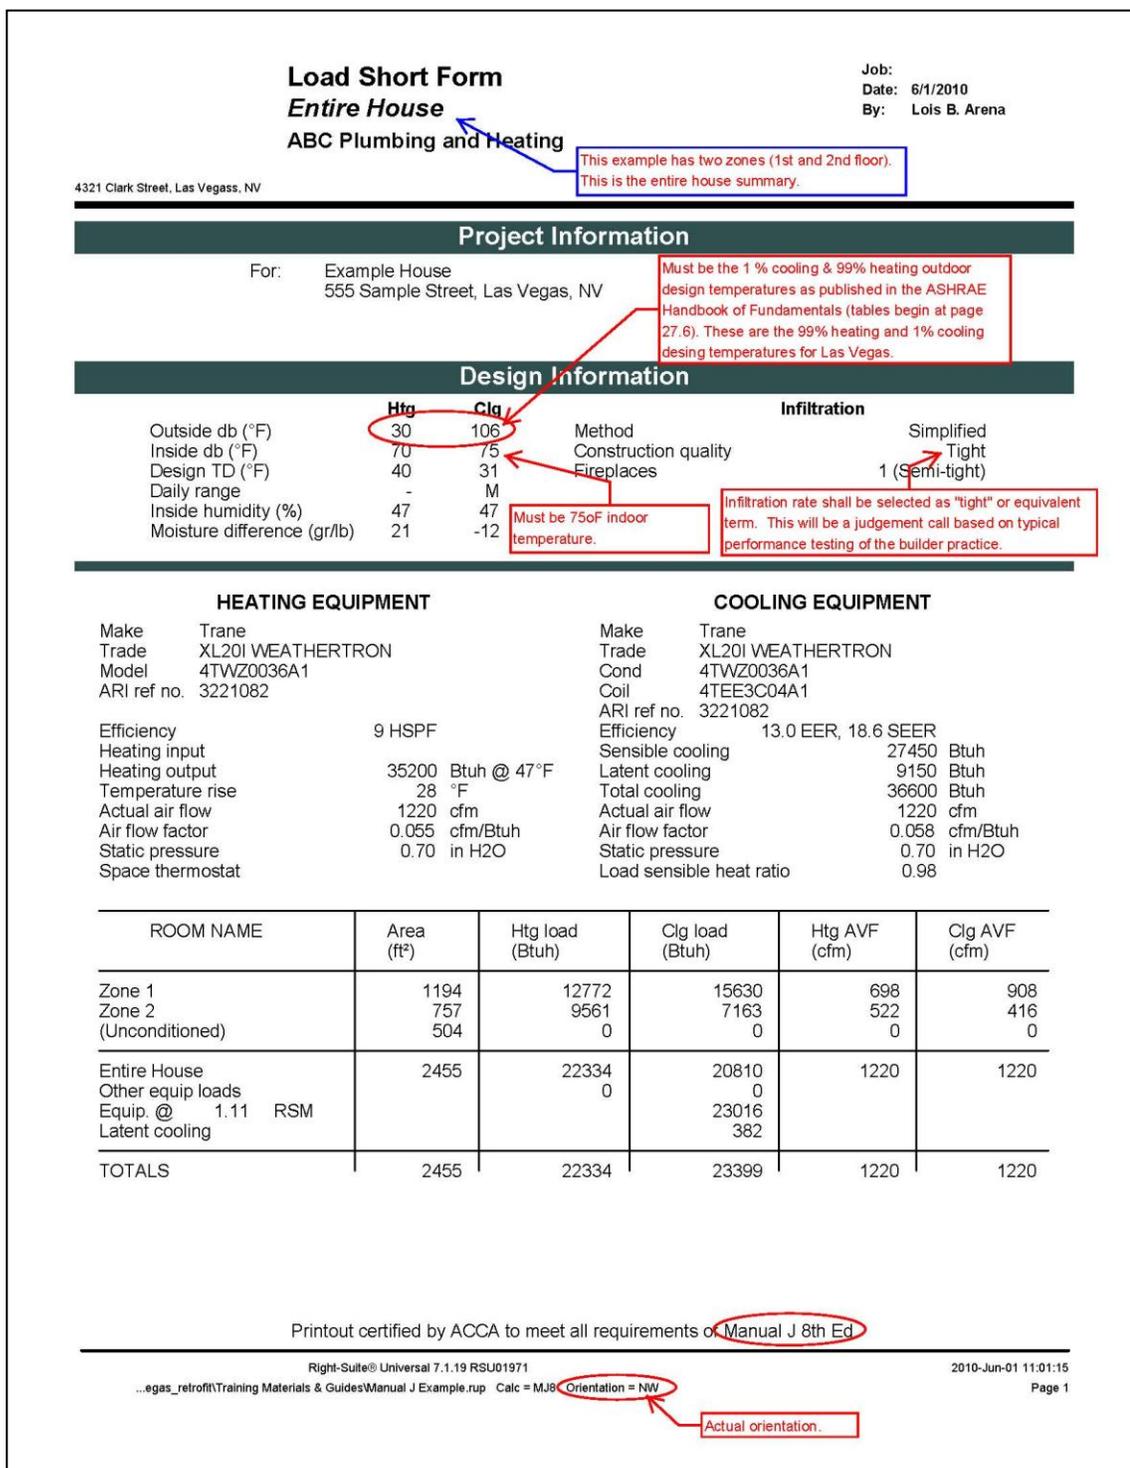

**Figure 1 Manual J Whole House Load Calculation – Report from Right-Suite® Universal**

**Component Constructions**  
**Entire House**  
 ABC Plumbing and Heating

Job:  
 Date: 6/1/2010  
 By: Lois B. Arena

4321 Clark Street, Las Vegas, NV

**Project Information**

For: Example House  
 555 Sample Street, Las Vegas, NV

**Design Conditions**

<b>Location:</b>		<b>Indoor:</b>		<b>Heating</b>	<b>Cooling</b>
Las Vegas Intl AP, NV, US		Indoor temperature (°F)		70	75
Elevation: 2178 ft		Design TD (°F)		40	31
Latitude: 36°N		Relative humidity (%)		47	47
		Moisture difference (gr/lb)		21.4	-12.0
<b>Outdoor:</b>	<b>Heating</b>	<b>Cooling</b>	<b>Infiltration:</b>		
Dry bulb (°F)	30	106	Method		
Daily range (°F)	-	25 ( M )	Simplified		
Wet bulb (°F)	15.0	66	Construction quality		
Wind speed (mph)		7.5	Tight		
			Fireplaces		
			1 (Semi-tight)		

**Construction descriptions**

	Or	Area ft²	U-value Btu/ft²·°F	Insul R ft²·°F/Btu	Htg HTM Btu/ft²	Loss Btu/h	Cig HTM Btu/ft²	Gain Btu/h
<b>Walls</b>								
12C-6sw: Frm wall, vnl ext, 1/2" wood shth, r-13 cav ins, 1/2" gypsum board int fnsh, r-8 ext bd ins, 2"x4" wood frm	ne	398	0.060	19.0	1.81	718	1.20	476
	e	106	0.060	19.0	2.40	255	1.59	169
	se	373	0.060	19.0	1.46	545	0.97	361
	sw	768	0.060	19.0	1.75	1347	1.16	893
	nw	555	0.060	19.0	1.68	932	1.11	618
	all	2200	0.060	19.0	1.73	3799	1.14	2517
<b>Partitions</b>								
12C-0sw: Frm wall, stucco ext, r-13 cav ins, 2"x4" wood frm		59	0.091	13.0	3.64	213	2.26	132
<b>Windows</b>								
2 glazing, clr low-e outr, argon gas, wd frm mat, clr innr, 1/2" gap, 1/4" thk; 2 glazing, clr low-e outr, argon gas, wd frm mat, clr innr, 1/2" gap, 1/4" thk; NFRC rated (SHGC=0.29); 50% drapes, medium; 2 ft overhang (2 ft window ht, 0 ft sep.)	ne	17	0.320	0	12.8	215	24.6	413
2 glazing, clr low-e outr, argon gas, wd frm mat, clr innr, 1/2" gap, 1/4" thk; 2 glazing, clr low-e outr, argon gas, wd frm mat, clr innr, 1/2" gap, 1/4" thk; NFRC rated (SHGC=0.29); 50% drapes, medium; 2 ft overhang (4.2 ft window ht, 0 ft sep.)	ne	21	0.320	0	12.8	269	24.6	516
2 glazing, clr low-e outr, argon gas, wd frm mat, clr innr, 1/2" gap, 1/4" thk; 2 glazing, clr low-e outr, argon gas, wd frm mat, clr innr, 1/2" gap, 1/4" thk; NFRC rated (SHGC=0.29); 50% drapes, medium; 2 ft overhang (6.7 ft window ht, 4.5 ft sep.)	ne	40	0.320	0	12.8	515	24.6	987
2 glazing, clr low-e outr, argon gas, wd frm mat, clr innr, 1/2" gap, 1/4" thk; 2 glazing, clr low-e outr, argon gas, wd frm mat, clr innr, 1/2" gap, 1/4" thk; NFRC rated (SHGC=0.29); 50% drapes, medium; 2 ft overhang (10.8 ft window ht, 4.5 ft sep.)	ne	162	0.320	0	12.8	2074	24.6	3979
2 glazing, clr low-e outr, argon gas, wd frm mat, clr innr, 1/2" gap, 1/4" thk; 2 glazing, clr low-e outr, argon gas, wd frm mat, clr innr, 1/2" gap, 1/4" thk; NFRC rated (SHGC=0.29); 50% drapes, medium; 2 ft overhang (1.5 ft window ht, 0 ft sep.)	se	8	0.320	0	12.8	96	13.9	105

**Figure 2 Component Construction Summary for Manual J Calculations**

**Example:**

From Figure 1 and Figure 2, determine:

- a) the total cooling design load,
- b) the minimum required air flow
- c) if the design temperatures were chosen correctly
- d) the orientation of the home
- e) the u-value of the windows
- f) the wall construction and insulation value

**Answers:**

- a) 23,399 Btuh
- b) 1220 cfm
- c) Yes, these are the correct design temperatures for Las Vegas, NV according to ACCA Manual J, Table 1. .
- d) Northwest
- e) 0.32
- f) 2x4 frame wall with R-13 cavity insulation

- 2.1.2 New and replacement air conditioning systems must be sized no larger than 115% (or the next nearest size available from the manufacturer) of total load at design conditions. (Systems must be sized based on load calculations referenced in **Section 2.1**)

After confirming that the load calculations were performed properly, the next step is to verify that the system was sized properly. Sizing should be performed in accordance with the procedures outlined in the ACCA's Manual S. Manual S is a guide for selecting and sizing residential heating and cooling equipment.

The installed capacity of the system can be found in the OEM (original equipment manufacturer) catalog or the AHRI (Air-Conditioning, Heating and Refrigeration Institute) certificate as show in Figure 3.

**AHRI CERTIFIED™**  
www.ahridirectory.org

### Certificate of Product Ratings

AHRI Certified Reference Number: 3492861      Date: 10/26/2009

Product: Split System: Air-Cooled Condensing Unit, Coil with Blower

Outdoor Unit Model Number: 113AE036-E

Indoor Unit Model Number: CAP13614A11\*315(A, J)AV036070

Manufacturer: BRYANT HEATING AND COOLING SYSTEMS

Trade Brand Name: LEGACY-RNC-13-PURON-AC

Manufacturer responsible for the rating of this system combination is BRYANT HEATING AND COOLING SYSTEMS

Rated as follows in accordance with AHRI Standard 210/240-2006 for Unitary Air-Conditioning and Air-Source Heat Pump Equipment and subject to verification of rating accuracy by AHRI-sponsored, independent, third party testing:

Cooling Capacity (Btuh):	32400
EER Rating (Cooling):	11.50
SEER Rating (Cooling):	13.50

A\* following a rating indicates a voluntary rerate of previously published data, unless accompanied with a WAS which indicates an involuntary rerate.

**AHRI CERTIFIED™**

DISCLAIMER  
AHRI does not endorse the product(s) listed on this Certificate and makes no representations, warranties or guarantees as to, and assumes no responsibility for, the product(s) listed on this Certificate. AHRI expressly disclaims all liability for damages of any kind arising out of the use or performance of the product(s), or the unauthorized alteration of data listed on this Certificate. Certified ratings are valid only for models and configurations listed in the directory at www.ahridirectory.org.

TERMS AND CONDITIONS  
This Certificate and its contents are proprietary products of AHRI. This Certificate shall only be used for individual, personal and confidential reference purposes. The contents of this Certificate may not, in whole or in part, be reproduced, copied, disseminated, entered into a computer database, or otherwise utilized, in any form or manner, or by any means, except for the user's individual, personal and confidential reference.

CERTIFICATE VERIFICATION  
This information for the model cited on this certificate can be verified at www.ahridirectory.org, click on "Verify Certificate" link and enter the AHRI Certified Reference Number and the date on which the certificate was issued, which is listed above, and the Certificate No., which is listed below.

2009 Air-Conditioning, Heating, and Refrigeration Institute

**AHRI** Air-Conditioning, Heating, and Refrigeration Institute

CERTIFICATE NO.: 120010424200148801

**Figure 3 AHRI Certificate of Product Ratings**

Simply noting the capacity of either the indoor or outdoor coil is not sufficient for determining the overall system capacity. The model numbers of both components must be recorded and looked up in the OEM catalog or the AHRI database to determine the actual installed capacity of the system. The technician is required to submit the AHRI

certificate for the new system for the job file. The database can be accessed at:  
<http://www.ahridirectory.org/ahridirectory/pages/home.aspx>.

Note that the AHRI certificate lists the model numbers for the indoor and outdoor coils, the capacity and the efficiency. The auditor can then verify that the model numbers on the certificate match those on the equipment installed in the field.

To determine if the installed capacity complies with the BPI sizing requirements, divide the installed capacity by the design load.

#### Example

Based on the loads in Figure 1 and the AHRI certification in Figure 3, determine if this system complies with the requirement of 2.1.2.

#### Answer

Design load: 23,399 Btuh  
 Installed capacity: 32,400 Btuh as shown on the AHRI certificate  
 % of design load:  $32,400 \div 23,399 \times 100 = 138\%$ .

Air conditioning systems are not supposed to be more than 115% of the total design load, BUT . . . if the next available size for the manufacturer was the unit displayed in the AHRI certificate below, then this system would be in compliance with BPI's sizing requirement. Some manufacturers do not have ½ ton increments, especially where very high efficiencies are concerned.

#### Example:

Determine the next available size of the cooling system from the previous example.

#### Answer:

1. Go to the AHRI database.
2. Click on Air Conditioners and Air Conditioning Coils
3. Select the manufacturer of the outdoor coil (see Figure 4)
4. To help narrow down the search, enter the SEER of the installed system as the minimum SEER, the Outdoor unit trade/Brand name if you have it, the next ½ size up from the design load.

Helpful Hint: When using the AHRI Directory in general, do not input too much information into the search directory, such as the complete model numbers, as this will typically result in no results. If you input the model number, only input the beginning portion.

Note that 1 ton is equal to 12,000 Btuh and ½ ton is equal to 6,000 Btuh. The smallest increments are usually ½ ton. In this case, the next available size would be 30,000 kBtu (or very close to that) if the manufacturer offered ½ ton increments.

AC Search - Windows Internet Explorer

http://www.ahridirectory.org/ahriDirectory/pages/ac/defaultSearch.aspx

File Edit View Favorites Tools Help

Google Search

Share Print Sidewiki Check Translate AutoFill

Convert Select

Favorites Suggested Sites Free HTML Web Slice Gallery

Web Mail Messages AC Search

Page Safety Tools

**AHRI** Air-Conditioning, Heating, and Refrigeration Institute **AHRI CERTIFIED** www.ahridirectory.org

Are you a Manufacturer? | [Sign In](#)

**AC Search**

Home

For more information about the Search fields, click [?](#) next to the search field.  
For search tips, refer to [FAQs](#).

AHRI Certified Reference Number		Model Status	All
AHRI Type	Please Select an AHRI Type	Outdoor Unit Model Number	
Outdoor Unit Manufacturer (Systems)	BRYANT HEATING AND COOLING SYS	Outdoor Unit Trade/Brand Name (Systems)	LEGACY RNC 13 PURON AC
Indoor Unit Manufacturer (Mix-Match Or Coil)	Please Select a Manufacturer	Indoor Unit Model Number	
Furnace Model Number		Cooling Cap. (Btuh)	Min. 30000 Max.
SEER (Btuh/Watt)	Min. 13.5 Max.	EER (Btuh/Watt)	Min. Max.
Phase	1-Phase or 3-Phase	Manufacturer Type	Systems and Mix-Match(Coil)
High Sales (Only applicable to Systems)	<input type="radio"/> Yes <input type="radio"/> No <input type="radio"/> No Preference	Exclusively for Canada Or Export	<input type="radio"/> Yes <input type="radio"/> No <input type="radio"/> No Preference
Eligible for Federal Tax Credit	<input type="radio"/> Yes <input type="radio"/> No <input type="radio"/> No Preference		

By clicking the Search Button, I agree to the [Terms and Conditions](#).

[Home](#) | [Contact Us](#) | [Terms and Conditions](#) | [License AHRI Directory Data](#)  
Copyright © 2010 Air-Conditioning, Heating, and Refrigeration Institute. All rights reserved.

Start Citrix XenApp - ... Inbox - Microso... AC Search - W... guidelines for C... P:\NETL03\_135... Right-Suite@U... Search Desktop 12:03 PM

**Figure 4 AHRI Database - Search Page**

5. Select search.
6. Click on the Capacity heading in the search results to sort from smallest to largest (see Figure 5).
7. If a 30, 000 Btuh unit shows up, the installed system does not comply with this requirement. The installer should have installed a smaller unit.

AC Search - Windows Internet Explorer  
 http://www.ahridirectory.org/ahridirectory/pages/sc/defaultSearch.aspx

Are you a Manufacturer? | Sign In

Home | Modify | Export

Double click on a row to view/print AHRI certificate.  
 AHRI certificates are not available for Obsolete AC and HP equipment.  
 Model Status of 'Active' means models are currently in production. 'Discontinued' means that the manufacturer has elected to stop producing, yet stock is still available. 'Obsolete' means that the manufacturer is required to stop manufacturing due to a test failure in the AHRI Certification Programs.


AHRI Certified Ref #	Model Status	Manufacturer Type	Trade/Brand Name	Outdoor Unit		Indoor Unit		Furnace Model	Cooling			AHRI Type	HSVTC	Est. National Avg. Annual Operating Cooling Cost (\$)	Eligible for Federal Tax Credit	
				Manufacturer	Model	Manufacturer (Mix-Match)	Model		Capacity (Btuh)	EER	SEER					Phase
3040822	Active	Systems	LEGACY RNC 13 PURON AC	BRYANT HEATING AND COOLING SYSTEMS	113ANC030-B		FE4AN(B,F) 005+UI		30000	11.50	15.00	1	RCU-A-CB		230	
3040823	Active	Systems	LEGACY RNC 13 PURON AC	BRYANT HEATING AND COOLING SYSTEMS	113ANC030-B		FE5ANB004+UI		30000	12.50	15.00	1	RCU-A-CB		230	
3040828	Discontinued	Systems	LEGACY RNC 13 PURON AC	BRYANT HEATING AND COOLING SYSTEMS	113ANC030-B		FV4BN(B,F)005		30000	12.30	15.00	1	RCU-A-CB		230	
3404662	Active	Systems	LEGACY RNC 13 PURON AC	BRYANT HEATING AND COOLING SYSTEMS	113ANC030-B		FV4CN(B,F)005		30000	12.30	15.00	1	RCU-A-CB		230	
3492861	Active	Systems	LEGACY RNC 13 PURON AC	BRYANT HEATING AND COOLING SYSTEMS	113AE036-E		CAP**3614A**	315(A,J) AV036070	32400	11.50	13.50	3	RCU-A-CB		276	
3250952	Active	Systems	LEGACY RNC 13 PURON AC	BRYANT HEATING AND COOLING SYSTEMS	113AN(A,W) 036-E		CAP**3614A**	315(A,J) AV036070	32400	11.50	13.50	1	RCU-A-CB		276	
3869830	Active	Systems	LEGACY RNC 13 PURON AC	BRYANT HEATING AND COOLING SYSTEMS	113AN036 (A,W)****F		CAP**3614A**	315(A,J) AV036070	32400	11.50	13.50	1	RCU-A-CB		276	

Figure 5 AHRI Database – Search Results

Required documentation: AHRI certificate or OEM performance data  
<http://www.ahridirectory.org/ahridirectory/pages/home.aspx>.

- 2.1.3 New and replacement heat pump systems must be sized no larger than 125% (or next nearest size available from the manufacturer) of total load at design conditions. (Systems must be sized based on load calculations referenced in **Section 2.1.**)

See previous example. Choose Heat Pumps & Heat Pump Coils on the main menu for the AHRI database and proceed as above.

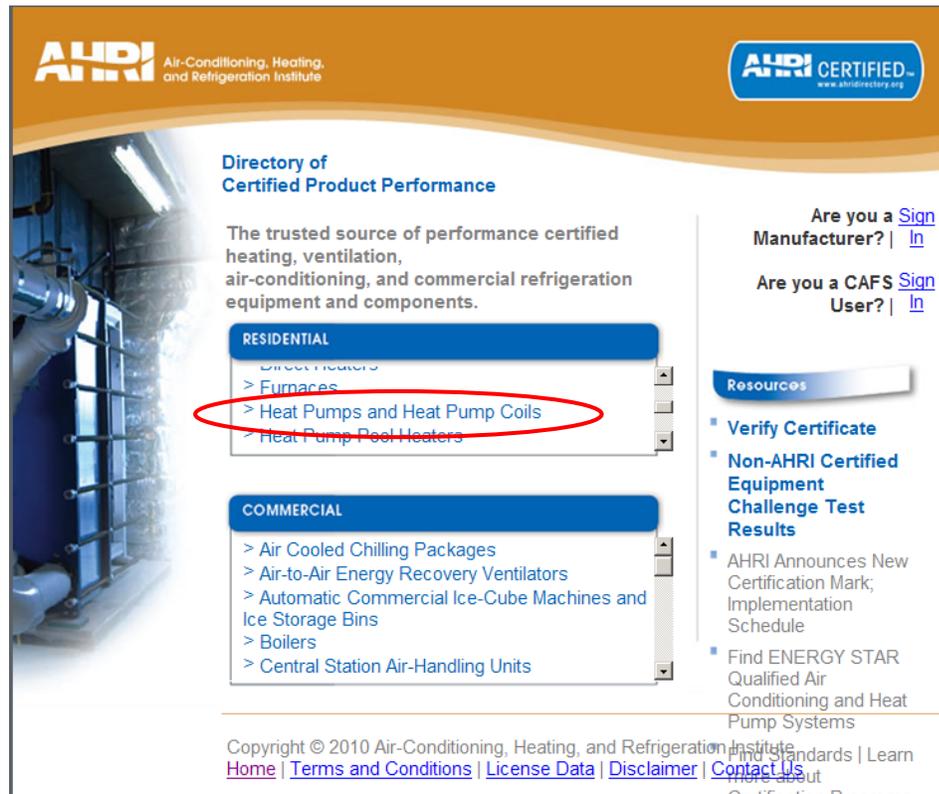

**Figure 6 AHRI Database – Heat Pump Selection**

For heat pumps, use the design cooling load when calculating the % of the design load, not the heating load.

- 2.1.4 When installing new systems or replacing the air-handler and/or the compressor unit for existing systems, the indoor evaporator coil must be correctly matched to the outdoor coil for the system according to the manufacturer's specifications or ARI standards.

The size of the indoor and outdoor coils are typically contained within the model numbers, but the installed capacity of the system takes into account the size of each individual part. For instance, just because the indoor coil is rated at 36 kBtuh doesn't mean the system will supply that amount of cooling if the outdoor coil is not the same size. Often, in areas with low humidity, the indoor coil will be slightly larger than the outdoor (usually not by more than ½ ton) to provide higher sensible capacity.

If the capacity of the indoor coil is different from that of the outdoor coil, it is required that new systems are correctly matched and the proper documentation has been provided to confirm the capacity of the system. Acceptable documentation may come from the manufacturer's literature or the AHRI website.

The following link will take you to the AHRI website where you can confirm the capacity and the efficiency for the installed components:

<http://www.ahridirectory.org/ahridirectory/pages/home.aspx>.

Example:

Look at the following model numbers and determine the size.

- a) 13ACD-018-230\*
- b) 13ACD-024-230\*
- c) 24ABB342(A,W)\*\*31
- d) CAP\*\*4824A
- e) 2TTX4048B1
- f) C(A,C,D,E)48D4X+TDR

Answer:

The capacity of the coils is divisible by 6. Look for numbers in the model number that are evenly divisible by 6.

- a)  $18 \text{ kBtuh} \div 12 \text{ kBtuh/ton} = 1.5 \text{ tons}$
- b)  $24 \text{ kBtuh} \div 12 \text{ kBtuh/ton} = 2.0 \text{ tons}$
- c)  $42 \text{ kBtuh} \div 12 \text{ kBtuh/ton} = 3.5 \text{ tons}$
- d)  $48 \text{ kBtuh} \div 12 \text{ kBtuh/ton} = 4.0 \text{ tons}$
- e)  $48 \text{ kBtuh} \div 12 \text{ kBtuh/ton} = 4.0 \text{ tons}$
- f)  $48 \text{ kBtuh} \div 12 \text{ kBtuh/ton} = 4.0 \text{ tons}$

2.1.5 Blower door test results are **recommended** to determine air leakage rates input into load calculations. Blower door ACH conversion:  $ACH = CFM50 \div N$  (use lowest N-factor for the region). If using Manual J version 8, enter CFM50. **Note: The above equation is incorrect. It should read  $ACH_n = ACH50 \div N$ .  $ACH50 = CFM50 \times 60 \div \text{Volume}$**

Before recommending HVAC upgrades for a home, a full energy audit should be conducted to determine the existing conditions of the home and any recommended shell improvements that will affect the size of the new air conditioning or heat pump system.

This audit should include a blower door test. The results of that test (or the projected air tightness after improvements have been made) should be used in the Manual J calculation for sizing the new equipment.




Some Manual J software programs will use a CFM50 which is measured directly with the blower door, and some use a qualitative description such as “tight”, “semi-tight”, etc. in accordance with the ACCA Manual J procedures. Verify that the value either looks reasonable or corresponds to the auditor’s test results. Table 1 (reproduced from the ACCA’s Manual J, 8<sup>th</sup> edition) shows the ACH<sub>n</sub> (natural air change rate) associated with each of the qualitative descriptors.

**Table 1 Tightness Categories Reproduced from Manual J, 8<sup>th</sup> Edition**

Default Air Change Values for Three or Four Exposures (from Manual J, 8th Edition)						
Construction	Air Changes per Hour (Heating)					Infiltration CFM for One Fireplace
	Floor Area of Heated Space (SqFt)					
	900 or Less	901 to 1500	1501 to 2000	2001 to 3000	3000 or more	
Tight	0.21	0.16	0.14	0.11	0.1	0
Semi-Tight	0.41	0.31	0.26	0.22	0.19	13
Average	0.61	0.45	0.38	0.32	0.28	20
Semi-Loose	0.95	0.7	0.59	0.49	0.43	27
Loose	1.26	0.94	0.8	0.66	0.58	33
For one additional fireplace, add 7 cfm to the above fireplace values. For two or more additional fireplaces, add 10 cfm (total) to the above.						
Air Changes per Hour (Cooling)						
Construction	Floor Area of Heated Space (SqFt)					Fireplace Infiltration
	900 or Less	901 to 1500	1501 to 2000	2001 to 3000	3000 or more	
Tight	0.11	0.08	0.07	0.06	0.05	None
Semi-Tight	0.22	0.16	0.14	0.11	0.1	
Average	0.32	0.23	0.2	0.16	0.15	
Semi-Loose	0.5	0.36	0.31	0.25	0.23	
Loose	0.67	0.49	0.42	0.34	0.3	

To verify that the designer used the correct descriptor for the design load calculations the ACHn will have to be calculated from the CFM50 number. To do this, multiply the CFM50 by 60 minutes/hour and then divide by the volume of the home and then by the n-factor. This factor was developed by Lawrence Berkeley Laboratory (LBL) and is based on the climate zone, number of stories and wind exposure.

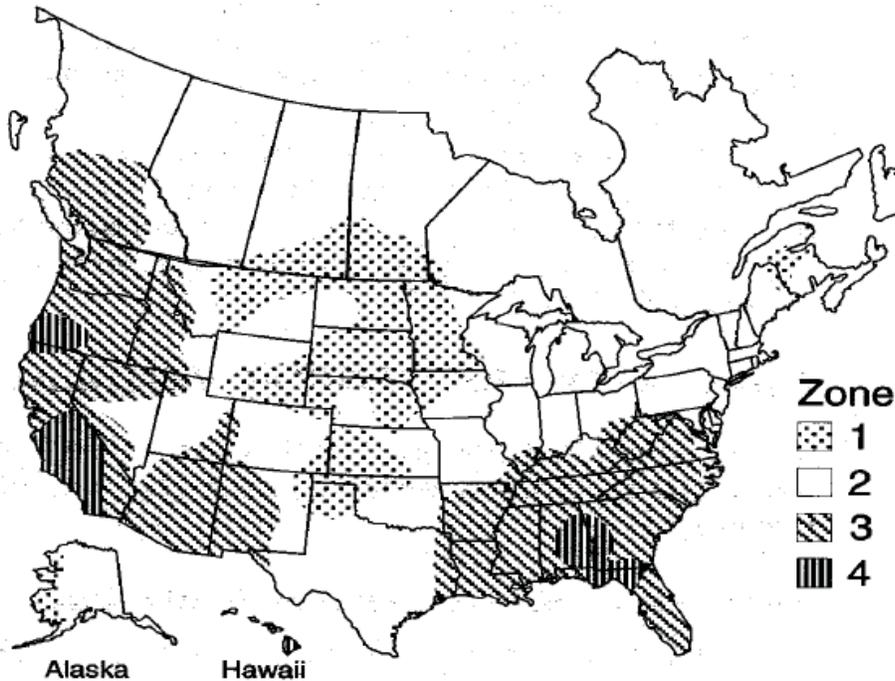

**Figure 7 Climate Zones for LBL's Air Leakage Factors<sup>3</sup>**

**Table 2 LBL's Factors for Climate Zones, # of Stories and Shielding<sup>4</sup>**

Zones		# of Stories		Shielding	
1	14-17	1	1	Well	1.2
2	17-20	1.5	0.89	Normal	1
3	20-23	2	0.81	Exposed	0.9
4	23-26	2.5	0.76		
		3	0.72		

The n-factor used in the ACHn calculations is the factor for the applicable climate zone, # of stories and shielding all multiplied together.

Refer to your equipments manual for specific procedures for conducting a blower door test.

<sup>3</sup> Sherman, M. "Estimation of Infiltration for Leakage and Climate Indicators," in *Energy and Buildings*, 10, 1987.

<sup>4</sup> Sherman, M. "Estimation of Infiltration for Leakage and Climate Indicators," in *Energy and Buildings*, 10, 1987.

**Example:**

The HVAC designer for an existing, 2 story home in Las Vegas, NV chose “average” for the air tightness level when calculating the size of the new equipment. The blower door number from the initial audit was 1,500 cfm50. No recommendations to air tightness were made. The size is 2,000 ft<sup>2</sup>, and the volume is 16,000 ft<sup>3</sup>. The home is located in a typical Las Vegas neighborhood. The lots are approximately 1/5 of an acre. Did the designer choose the correct air tightness level for the calculation?

**Answer:****Step 1. Calculate the ACHn**

- a) Determine the Zone factor: Las Vegas is Zone 3. From Table 2, the zone factor is 20 (choose the lower limit)
- b) Determine the height factor: This is a 2 story home, the height factor is 0.81.
- c) Determine the shielding factor: This is a typical neighborhood, the shielding factor is 1.
- d) Calculate the n-factor:  $20 \times 0.81 \times 1 = 16.2$
- e) Calculate the ACHn:  $1500 \text{ CFM50} \times 60 \text{ m/hr} \div (16,000 \times 16.2) = 0.35$

**Step 2. Determine the tightness level from Table 1**

- f) At 0.35 ACHn, the tightness level for “heating” (as the house was placed in winter conditions for blower door testing) would be closet to “average”. So yes, the designer chose the correct level.

2.1.6 New ducted distribution systems must be designed to provide +/- 15% of room airflow requirements to satisfy calculated Btu loads for each room being conditioned.

For this step, room by room load calculations are needed in conjunction with a duct design using the ACCA's Manual D or equivalent. For a forced air system that supplies both the heating and cooling, the room load calculations should produce a cfm number for both heating and cooling for each room. According to Manual D guidelines, the higher of the two should be used on the duct design unless seasonal balancing is pragmatically unacceptable, in which case, design air flow values may equal the average of the heating and cooling cfm. The HVAC designer should note which method was used. The designer is required to design a system that will meet these room loads within +/-15%.

As can be seen in room by room load calculations in Figure 8, for each room load, a corresponding cfm is calculated to satisfy that load. Compare the cfm numbers from the room by room load calculations to the designer's cfm numbers on the duct design. These numbers should be within +/- 15% of each other.

The HVAC designer is required to provide the room by room calculations as well as the duct design for new systems.

When designing a new duct system, the designer should always try to keep the ducts out of unconditioned spaces like attics. If this is not possible, duct runs should be kept as short as possible and buried under the attic insulation. Care should also be taken not to throw air directly onto the occupants. Locate the registers at one end of the room and throw the air across the ceiling toward the opposite wall using registers designed for the throw required.

Example:

Using Figure 8 and Figure 9, determine if the cfm on the duct layout drawing for the Living Room and the Den are with +/- 15% of design cfm.

Answer:

A) Living Room Design Flow from Figure 8: 286 cfm (use heating because it is bigger)

Living Room Flow on Duct Design (Figure 9): 264 cfm

$(1 - 264 \div 286) \times 100 = 7.7\%$  - yes, meets requirements

B) Den Design Flow from Figure 8: 156 cfm (use heating because it is bigger)

Den Flow on Duct Design (Figure 9): 122 cfm

$(1-122 \div 156) \times 100 = 21.8\%$  - no, does not meet the requirement. The designer should be designing to meet the higher of the heating or cooling loads or an average of both. The value shown on Figure 9 for the Den is neither.

This calculation should be done for each room. There is a Register Flow & Room-to-Room Pressure Form in the appendix for recording design and measured air flows. It can be used to verify compliance with this item and 3.1.1.

**Load Short Form**  
**Zone 1**  
**ABC Plumbing and Heating**

Job:  
 Date: 6/1/2010  
 By: Lois B. Arena

4321 Clark Street, Las Vegas, NV

**Project Information**

For: Example House  
 555 Sample Street, Las Vegas, NV

**Design Information**

	Htg	Clg	Method	Infiltration
Outside db (°F)	30	106	Method	Simplified
Inside db (°F)	70	75	Construction quality	Tight
Design TD (°F)	40	31	Fireplaces	1 (Semi-tight)
Daily range	-	M		
Inside humidity (%)	45	45		
Moisture difference (gr/lb)	14	-4		

**HEATING EQUIPMENT**

Make n/a  
 Trade n/a  
 Model n/a  
 ARI ref no. n/a  
 Efficiency n/a  
 Heating input 0 Btuh  
 Temperature rise 0 °F  
 Actual air flow 0 cfm  
 Air flow factor 0 cfm/Btuh  
 Static pressure 0 in H2O  
 Space thermostat n/a

**COOLING EQUIPMENT**

Make n/a  
 Trade n/a  
 Cond n/a  
 Coil n/a  
 ARI ref no. n/a  
 Efficiency n/a  
 Sensible cooling 0 Btuh  
 Latent cooling 0 Btuh  
 Total cooling 0 Btuh  
 Actual air flow 0 cfm  
 Air flow factor 0 cfm/Btuh  
 Static pressure 0 in H2O  
 Load sensible heat ratio 0


Room by room load calculations

ROOM NAME	Area (ft²)	Htg load (Btuh)	Clg load (Btuh)	Htg AVF (cfm)	Clg AVF (cfm)
Living Room	378	5230	4552	286	264
Dining	169	2523	4497	138	261
Den	222	2858	2099	156	122
Kitchen	170	232	2555	13	148
Hall	249	1929	1927	105	112
Closet 2	7	0	0	0	0
Zone 1	1194	12772	15630	698	908
Other equip loads		0	0		
Equip. @ 1.11 RSM			17287		
Latent cooling			733		
<b>TOTALS</b>	<b>1194</b>	<b>12772</b>	<b>18020</b>	<b>698</b>	<b>908</b>

*Bold/italic values have been manually overridden*

Printout certified by ACCA to meet all requirements of Manual J 8th Ed.


**Figure 8 Manual J Room by Room Load Calculations**

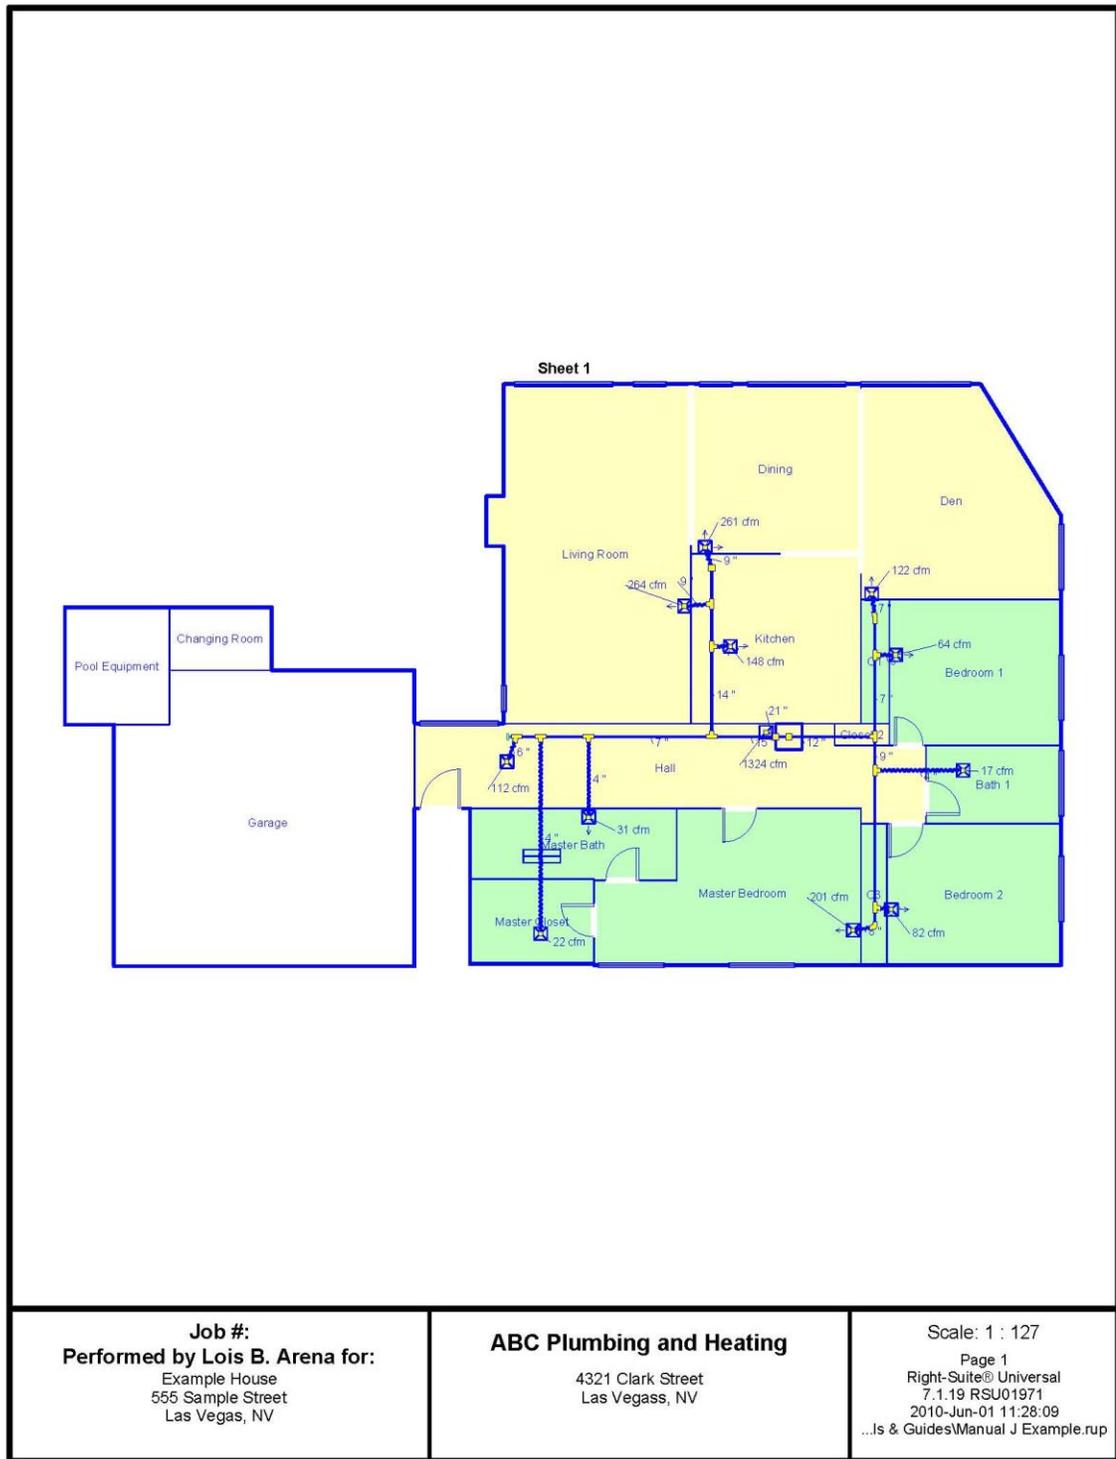

**Figure 9 Sample Duct Design**

2.1.7 New ducted distribution system designs shall be based on the available external static pressure from the air handler, the pressure drop of external devices, the equivalent length of the runs, as well as the size, type and configuration of the ducts.

In addition to the room by room calculations and the duct layout, the designer is required to provide all the information specified in 2.1.7 as listed above. The distribution design should provide a system that results in a friction rate between 0.06 and 0.18 in/100ft<sup>2</sup> to be compliant. Figure 10 is a sample report properly displaying this information.

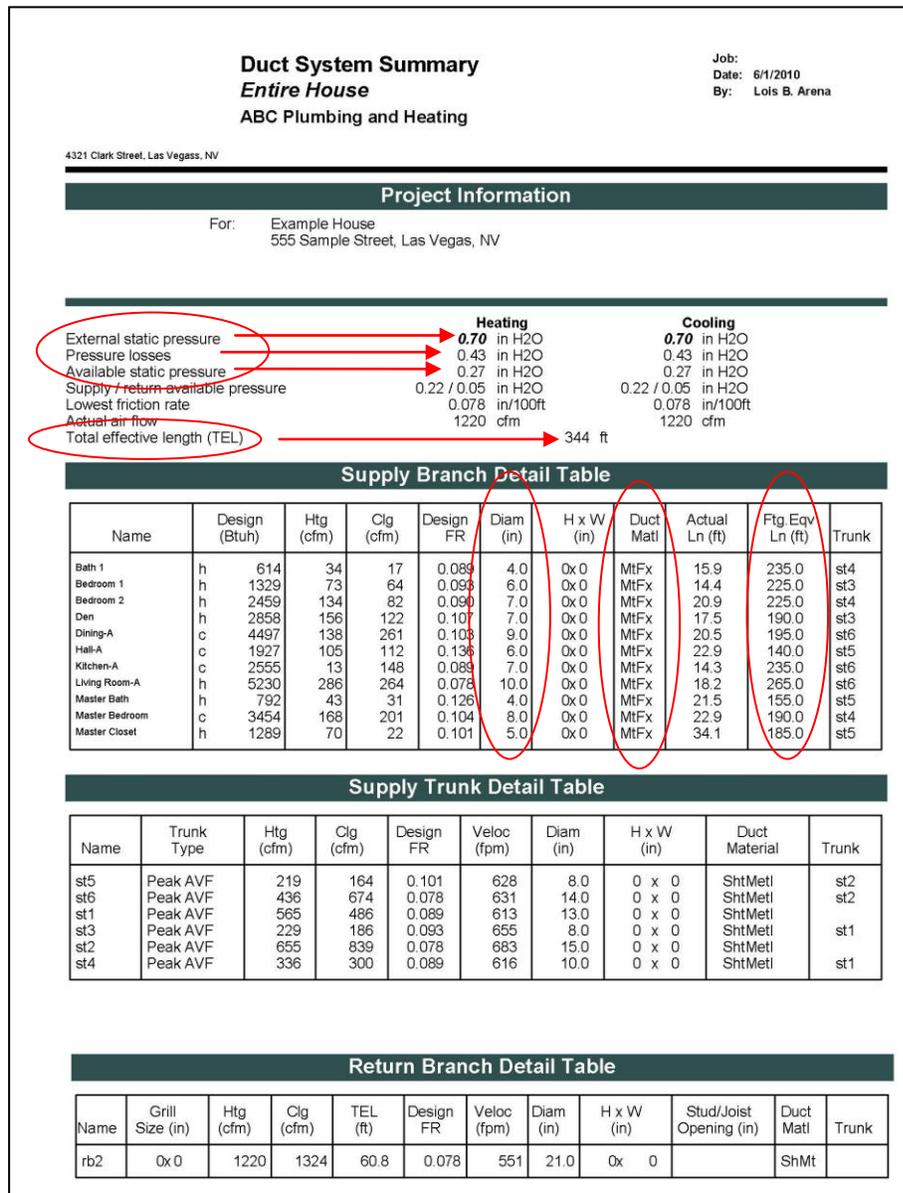

**Figure 10 Duct Design Details Based on Room by Room Load Calculations**

2.1.8 Airflow terminations for newly installed duct systems must have a documented design for proper spread and throw to effectively distribute heating/cooling to the room. Design throw must be between 80-120% of the distance to the furthest room surface (wall, ceiling, floor) from the termination.

In addition to the details shown in Figure 10, the designer/HVAC technician must provide manufacturer’s information for the supply registers selected. Manufacturer, model number room name, dimensions and throw should be listed for each register. Figure 11 is from a register manufacturer’s product catalog for residential ceiling registers. For each size, the throw (listed in feet) and cfm delivered is listed for a specific velocity. Systems should be designed to deliver air velocities of 500-700 fpm at each supply register. Lower flows will reduce mixing in the space resulting in comfort problems and higher throws may produce objectionable noise.

### Engineering Data


#### A500 Series (Page 26, 27)

##### A501MS/A501OB 1-Way Diffuser



Face Velocity		400	500	600	700	900	1100	1500
Pressure Loss		.010	.016	.022	.031	.050	.075	.140
6x6 Ak .13	cfm Throw	55 5	65 6	75 7	90 8	120 10	140 12	195 15
8x8 Ak .20	cfm Throw	75 6	90 7	105 8	120 10	150 12	190 15	240 18
10x10 Ak .29	cfm Throw	115 7	135 8	155 10	175 12	235 15	290 19	395 24
12x12 Ak .42	cfm Throw	170 8	210 10	255 12	300 15	390 19	470 24	610 29
14x14 Ak .50	cfm Throw	250 11	305 13	360 15	410 18	505 24	610 30	800 35

##### A504MS/A504OB 4-Way Diffuser



Face Velocity		400	500	600	700	900	1100	1500
Pressure Loss		.010	.016	.022	.031	.050	.075	.140
6x6 Ak .13	cfm Throw	55 2	65 3	75 4	90 5	120 6	140 7	195 9
8x8 Ak .20	cfm Throw	75 3	90 4	105 5	120 6	150 8	180 10	240 13
10x10 Ak .29	cfm Throw	115 4	135 5	155 6	175 7	235 9	290 12	395 14
12x12 Ak .42	cfm Throw	170 5	210 6	255 7	295 8	390 10	470 12	610 15
14x14 Ak .50	cfm Throw	250 6	305 7	360 8	410 9	505 11	610 14	800 18

Figure 11 Ceiling Register Data<sup>5</sup>

The auditor must verify that the specified register has a throw between 80 to 120% of the distance to the furthest room surface from the termination.

<sup>5</sup> <http://www.hartandcooley.com/tools/submittal-drawings/residential-grilles-registers-and-diffusers.aspx>

**Example:**

If a 1 way, 10 x 10 ceiling register is selected for the Den in the previous example (see Figure 8), does it meet the requirement of item 2.1.8? The dimensions of the Den are 13' wide by 12' deep by 9' tall.

**Answer:**

- a) Den design flow rate: 156 cfm
- b) Velocity of that supply trunk: 655 fpm (see st3 in Figure 10).
- c) Maximum flow rate of the 1 way diffuser in Figure 11 at 600 fpm: 155 cfm with 10' throw.
- d) Farthest surface (opposite wall) is no more than 13' feet away from the register. You can assume that the register is set off the closest wall by at least 1 foot, bringing the distance from the register the farthest surface down to 12'.
- e) % Distance to the Farthest Surface:  $10 \div 12 \times 100 = 83\%$ . Yes, this register meets the requirement.

## 2.2 Airflow

### 2.2.1 For all new duct systems:

- Measured heat pump airflow must be between 375-450 cfm/ton or within manufacturer's specifications when measured over a dry coil (heating mode).
- Measured air conditioner airflow must be at least 350 cfm/ton unless the manufacturer specifies a lower airflow for the local design condition, when measured over a wet coil after a minimum of 15 minutes of run time.

Often in arid climates with very little latent load like Las Vegas, the airflow of the cooling system is increased above the limits listed above to provide higher sensible capacity.



According to the Home Performance Specifications for Warm Climates, design airflows should be between 400 to 480 cfm/ton for locations like Las Vegas.

It is important to understand that balancing flows at each register will affect the total system airflow because dampers are usually used to divert air to and from different rooms. Once total system airflow is determined, balancing should be attempted. Airflow should be re-measured if significant adjustments were made during balancing.

Another important indicator of adequate airflow is the total external static pressure (TESP) of the system. All the components of a forced air system – the ducts, filters, registers and coils - create resistance which can be measured in either inches of water column (IWC) or pascals: the higher the TESP, the lower the airflow through the system. Higher TESP's can lead to shorter fan life and increased energy use. If manufacturer's tables are available, the TESP can be used to estimate airflow. Maximum recommended static pressures are usually around 0.5 IWC for standard air handlers.

Static pressure measurements can also help determine where there are restrictions in the system. For instance, high static pressures on the supply but not on the return would indicate that the system is restricted on the supply side. Focus should be placed on correcting problems in the supply ductwork which may include removing kinks, installing larger ducts or more supply registers where needed.

**NOTE: Measuring TESP is a requirement of the Clark County Community Resources Management Division in Las Vegas, NV, NOT BPI or HPS.**

Following are the steps necessary to fill in the Field Checklist for this item.

#### A. Determine Cooling System Tons

To determine the tonnage of the cooling system:

1. Refer to the AHRI certificate or the OEM data for the system installed.
2. Take the capacity and divide by 12,000 Btu/ton to determine the tons of the system.

## B. Test Total System Airflow

There is more than one method for determining the airflow of the system. For consistency, it is recommended that one of the following two methods is used by the auditor.

### Pressure Matching Method

The fan from duct leakage testing equipment may be used to test for system airflow. This test is done with the registers unsealed, so it should be done prior to setting up for the duct leakage test. Refer to the user's manual of the particular duct leakage testing equipment being used for a complete set of instructions on conducting this test. The basic steps are summarized below:

1. Turn off the air handler.
2. Open a window or door between the building and outside to prevent pressure changes during the test.
3. Make sure all supply and return registers are open and not taped. Filter should be in place
4. Insert a static pressure probe into the supply plenum or in a main supply trunk line a few feet away from the supply plenum. Make sure the probe is pointing into the air stream.
5. Connect the probe to one end of a piece of tubing and the other end of the tubing to the pressure gauge (see equipment manual for detailed instructions).
6. Turn the thermostat to the AC fan setting (or on high). Typically, electronic thermostats are equipped with a 15-minute staging timer. This timer prevents the 2-stage system from operating at high-stage until unit has been operating in low-stage for 15 minutes unless there is at least a  $\pm 5^{\circ}\text{F}$  difference between room temperature and thermostat set point. To force high-stage (after a minimum of 2 minutes in low-stage), adjust the set point at least  $\pm 5^{\circ}\text{F}$  below room temperature. This might vary depending on the brand and thermostat, so to ensure the system runs on high for the test, set the thermostat as low as possible and wait 15 minutes.
7. Once the system is running at high speed, measure the pressure in the supply.
8. Turn the system off at the thermostat and the emergency switch.
9. Seal off the return side of the system as close to the blower compartment as you can. This is usually done from inside the blower compartment or at the filter slot. The more completely you are able to isolate the air-handler and supply side of the system, the more accurate your test will be.
10. Once the return has been sealed off, install the



- duct leakage testing equipment fan on the air handler cabinet.
11. Turn the air handler on high again.
  12. Monitor the pressure in the supply duct and turn on the duct leakage testing equipment fan until the normal operating pressure has been reached.
  13. Record the airflow. This is the total system airflow.

### Flow Grid Test

A quicker and easier method for testing system airflow is using a flow grid. The flow grid is installed in the filter slot of the existing system and uses a pressure manometer to measure system operating pressure and flows. The basic steps are as follows:

1. Turn off the air handler.
2. Open a window or door between the building and outside to prevent pressure changes during the test.
3. Make sure all supply and return registers are open and not taped. Filter should be in place
4. Insert a static pressure probe into the supply plenum or in a main supply trunk line a few feet away from the supply plenum. Make sure the probe is pointing into the air stream.
5. Connect the probe to one end of a piece of tubing and the other end of the tubing to the pressure gauge (see equipment manual for detailed instructions).
6. Turn the thermostat to the AC fan setting (or on high). Typically, electronic thermostats are equipped with a 15-minute staging timer. This timer prevents the 2-stage system from operating at high-stage until unit has been operating in low-stage for 15 minutes unless there is at least a  $\pm 5^{\circ}\text{F}$  difference between room temperature and thermostat set point. To force high-stage (after a minimum of 2 minutes in low-stage), adjust the set point at least  $\pm 5^{\circ}\text{F}$  below room ambient. This might vary depending on the brand and thermostat, so to ensure the system runs on high for the test, set the thermostat as low as possible and wait 15 minutes.
7. Once the system is running at high speed, measure the pressure in the supply.
8. Turn the system off at the thermostat and the emergency switch.
9. Remove the filter and insert the flow grid into the filter slot using the correct flange attachments to ensure complete coverage of the return airflow path.
10. Connect the pressure taps from the flow grid to the pressure gauge.
11. Turn the air handler on high again.
12. Record the airflow.

Consult the flow grid's operating instructions for detailed instructions on how to properly hook up the equipment and use the gauges.

The above two airflow test methods are the most common methods used by energy auditors. There are other approved test methods for measuring airflow. These are more likely to be used by HVAC technicians and include:

- Pressure drop across the coil: HVAC equipment manufacturers have developed pressure drop data for their equipment. Static pressure (SP) drop across the coil is converted to CFM of air through the use of charts or graphs in the OEM installation/startup instructions. Equipment manufacturer's directions for the placement of measuring probes must be followed. The proper table must be used depending on whether the test is performed over a wet or dry coil. Oil-filled or digital manometers can be used.
- Traverse using an anemometer: Traversing involves taking readings over a predetermined grid pattern and using those readings to calculate airflow through the duct at that location. The average airflow velocity across a representative cross section of duct is measured in feet per minute (FPM) and then multiplied by the area in square feet to obtain the final volume in cubic feet per minute (CFM). For more detailed information on how to perform a traverse, see the ACCA's "Technician's Guide for Quality Installations" and/or your equipment's user's manual.
- Temperature rise method: This is a common test performed by HVAC technicians to verify airflow. This test can only be used for heating equipment including electric, gas or oil furnaces. This cannot be performed in cooling mode.

### **C. Determine Airflow/Installed Ton (cfm/ton)**

1. Measure the airflow of the system as described above.
2. Divide the total airflow by the tonnage calculated in Step A. This will yield cfm/ton.

### **D. Evaluate Total External Static Pressure**

1. Drill a hole in the supply plenum just above the air handler but before the evaporator coil.
2. Drill a hole in the return plenum between the filter and the air handler.
3. Connect one end of the tubing to the upper tap of the manometer on the A side and the other end to a pressure tap.
4. Make sure the manometer is set up to read pressures.
5. Set the air handler to operate at maximum speed (see B.6 above).
6. Insert the pressure tap into the hole on the supply side and record the static pressure. (if reading is in Pascals, you can convert to IWC by dividing by 249.1)
7. Record static pressure on return side (should be negative).
8. Eliminate the negative sign from the return reading and add the numbers together. This is the total external static pressure.
9. How does this number compare to the manufacturer's recommendation? If necessary, reduce the TESP by adjusting the blower speed, making changes to ductwork, cleaning system components, etc.

- 2.2.2 For new systems (when not installing new ductwork): Air conditioner or heat pump airflow must be within the design parameters of the manufacturer's specifications with a minimum of 325 CFM/Ton before proceeding with refrigerant charge corrections based on the results of the appropriate charging tests.

See previous section for calculation and airflow testing methods.

Airflow testing and corrections and room airflow balancing should be conducted before refrigerant charge is tested.



According to the Home Performance Specifications for Warm Climates, design airflows should be a minimum of 400 cfm/ton before proceeding with refrigerant charge corrections.

Example:

The contractor measured the airflow of the system at 1,000 cfm using a flow plate. The cooling system capacity is 36,000 Btuh. Does the airflow meet the requirements in 2.2.2?

Answer:

Airflow/ton:  $1,000 \text{ cfm} \div (36,000 \text{ Btuh} \div 12,000 \text{ Btuh/ton}) = 333 \text{ cfm/ton}$  – yes, the system meets the requirements of 2.2.2.

NOTE: Although this system meets the requirements of 2.2.2, the flow is below those recommended in 2.2.1 of the standard. The next requirement, 2.2.3 actually requires that the contractor attempt to bring the system into compliance with 2.2.1.

Any adjustments to the airflow will result in the need to retest the charge, so it is best to try and bring the flows to the levels specified in 2.2.1 before testing the charge.

- 2.2.3 For new systems (when not installing new ductwork): The contractor must attempt to bring the airflow within the ranges set in **2.2.1** by opening registers, opening dampers, changing blower speed, replacing filters, and removing obvious easily repaired kinks in flex duct systems. If the above repairs do not bring the unit into compliance, the contractor shall inform the customer that duct system revisions are necessary.

The contractor should provide written documentation of steps taken to bring the airflows into compliance and make recommendations for repairs if those airflows were not achieved.

## 2.3 Duct Systems

- 2.3.1 New ducted distribution systems must provide for adequate return air pathways to minimize pressure imbalances in the conditioned space. Room to room pressure differences may not exceed 3 Pascals.

### Room to Room Pressure Measurements

1. Turn on the air handler to high - cooling usually (see item 2.2.1 for information on how to force the system to run on high)
2. Close all interior doors
3. Connect tubing to Channel A Input tap and leave the bottom Reference tap open.
4. Set the gauge to measure pressures on both Channel A and B.
5. While standing in the center of the house or hallway, place the hose from the gauge under each door and record the pressure difference from each room with respect to the main body of the house (note the presence of a negative/positive sign)
6. Rooms should not be pressurized or depressurized by more than 3 Pa.

Pay particular attention to rooms which contain combustion equipment – gas fired water heaters, gas stoves & fireplaces, etc.

If larger differentials are noted, the contractor or auditor should make recommendations to bring the home into compliance. Typically, in a home without return ducts in every room, the bedrooms will be pressurized when the doors are closed, especially if the doors are not undercut and there are no jump ducts. If the bedrooms are pressurized compared to the central zone, some possible fixes include the installation of transfer grills, jump ducts and additional return registers.

- 2.3.2 Filter slots must be tightly covered and the cover must be easily removed for cleaning and/or replacement.

Below are some examples of unacceptable filter slots. The best option is to have a factory-built filter compartment.



**Figure 12 Examples of Unsuitable Filter Slots**

- 2.3.3 New ducted distribution systems must have sheet metal and flexible ductwork **both** mechanically fastened and sealed at all connections. Sealing shall use duct mastic or similar product designed for sealing ducts. Duct tape is not an allowable duct sealing material. UL standard (UL 181, UL 181A, or UL 181B) duct tape may be used only at the plenum connection to the air handler cabinet.

### Duct Sealing Techniques

Appropriate duct sealing materials are limited to products that have earned the Underwriter's Laboratory label for duct closure systems. These are:

- **UL-181A:** Closure Systems for Use with Rigid Ducts
- **UL-181B:** Closure Systems for Use with Flexible Air Ducts and Air Connectors

Labeled products consist of mastic, butyl tape, and some pressure-sensitive tapes. Mastic and butyl tape are the only products that are recommended for duct sealing in existing homes (in spite of what UL has labeled). This is due to the fact that the UL procedure for pressure-sensitive tapes requires mechanical fasteners (i.e. metal clamps), which are virtually never used in the field, and that the UL procedure assumes the duct surface is clean prior to installation. If duct surfaces are cleaned (using denatured alcohol or similar solvent), pressure-sensitive tapes may be effective sealants, but the UL testing procedure does not adequately address this.

#### Butyl Tape

Butyl tapes are an attractive option for duct sealing because they are more pliable than most standard metal tapes, they are relatively easy to install, and they leave a neater, more finished appearance than mastic. On the downside, butyl tape is expensive and may be subject to melting if the ducts become very hot.

#### Mastic

Duct mastic is a material similar to joint compound. It is sold in caulk tubes and buckets and may be applied using a paintbrush or other applicator. When storing mastic, it is best to keep it from freezing even if the manufacturer's instructions indicate that freezing will not damage the product. Most mastics are water soluble prior to curing but are waterproof once cured.


Mastic may be used to seal holes and cracks up to approximately  $\frac{1}{4}$ " in size. Holes larger than  $\frac{1}{4}$ " require additional support. Mesh tape (the type used by drywall installers) may be used as a bed for the mastic when larger holes are sealed.



### Sealing Applications and Techniques:

The following are some applications that will require repair work beyond simply applying a coat of mastic.

1. *Flexible duct connectors to trunk lines.* These connectors are typically secured to the main trunk line by means of “finger joints”. Finger joints are just tabbed collars that are inserted into the hole in the trunk line and the tabs are folded over to hold the collar in place. This makes for a very leaky connection. To seal around a round collar with finger joints, mesh tape is needed to hold the mastic in place. Cut a piece of mesh tape long enough to wrap 1-1/2 times around the diameter of the collar. Fold the mesh tape in half several times, then cut a slit from the exposed long edge of the tape, about halfway through the width of the tape. Unfold the tape and wrap it around the collar with the cut tabs against the flat surface of the trunk duct. This will provide a surface for mastic to stick to on both the collar and the trunk at the same time.

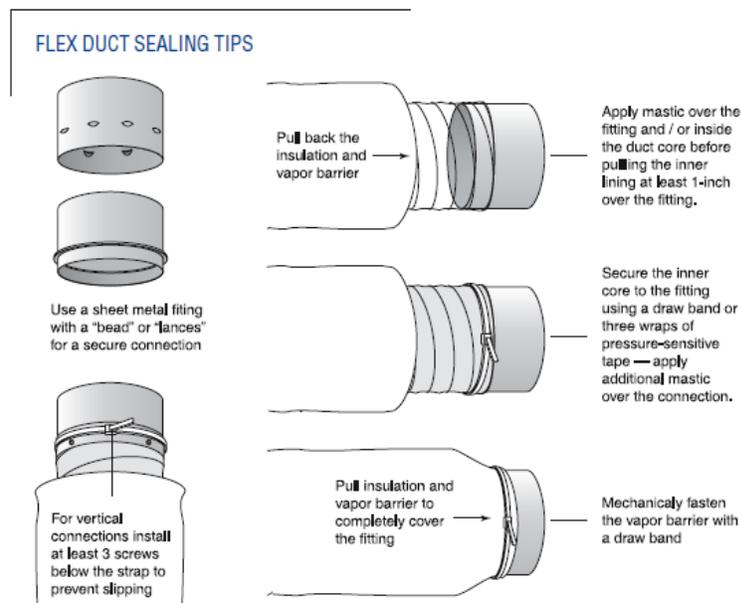

**Figure 13 Tips for Sealing Flex Duct<sup>6</sup>**

2. *Under cabinet kickplates.* Commonly found in kitchens, a duct is run up through the subfloor before the cabinets are installed, then a register is cut into the cabinet kickplate. The idea is that the air from the duct is supposed to travel under the cabinet and out through the register. More often, the air travels under the cabinet and never makes it out the register. In this case, the duct sealer will have to access under the cabinet and make sure that the air has an



<sup>6</sup> Technology Fact Sheet: “Air Distribution System Installation And Sealing”. March 2003. DOE/GO102003-0783

enclosed space to travel through. This may mean sealing the perimeter of the space under the cabinet, sealing the floor openings from the basement below, or even building a duct to connect the floor opening to the register.

3. *Panned joist bays.* A common practice to save money on installation is to use a basement ceiling joist bay in place of a fully ducted return duct. This is typically done by installing sheet metal “panning” over the bottom of the joists and connecting the joist bay to the duct system on one end and a floor register on the other end. While not a recommended practice, it is relatively easy to seal this type of return. Mastic may be applied to the joint between the panning and the joist, with or without mesh tape, depending on the size of the gaps. It is usually not necessary to seal the joist to the sub-floor unless it is clearly not sealed tight. When sealing panned joist bays, make sure to check the end of the “duct” run to be sure an end cap has been installed and is well-sealed. This is an often overlooked detail in this type of system.



4. *Platform returns.* Upflow air handlers are sometimes installed sitting on top of a plywood box, which is used as the return-side plenum. This is also a money-saving technique contractors use to avoid the added cost of a fully ducted sheet metal return. These are called “platform” returns. It is not uncommon to find that the box only has 4 sides and the cement of the basement floor is serving as the bottom of the plenum. In this case, the joint between the plywood and the floor will need to be sealed with plenty of mastic and mesh tape. In addition, all of the corners of the box and the connection between the box and the air handler all need to be sealed. Sealing may be done either from inside or outside the box, depending on what is more accessible.




5. *Building cavities.* Sometimes, entire building cavities (wall cavities, plumbing chases, or other interstitial spaces) may be being used as part of the ducts. Again, this is typically done on the return side of the system to save money in construction. These situations are particularly problematic because the duct system may be drawing air that is extremely hot or cold, and because the return may be drawing dust and other pollutants into the system. A combination strategy of air sealing, duct sealing, and possibly the installation of a duct where there is none may be required. These situations should be evaluated on a case by case basis to determine the best approach. They are more

expensive to repair but then again, they are very large leaks that may have very high energy penalties associated with them.

6. *Register boots.* Whether registers are located in ceilings, walls, or floors, they are rarely installed so that the space between the metal duct and the building envelope (drywall, subfloor, etc.) is air tight. This gap can easily be sealed by removing the register grill and using mastic in a caulk tube. When the grill is removed, the technician should also reach inside the boot to seal the joint between the boot and the take-off duct.



#### BOOT AND DUCT CONNECTION HIGHLIGHTS

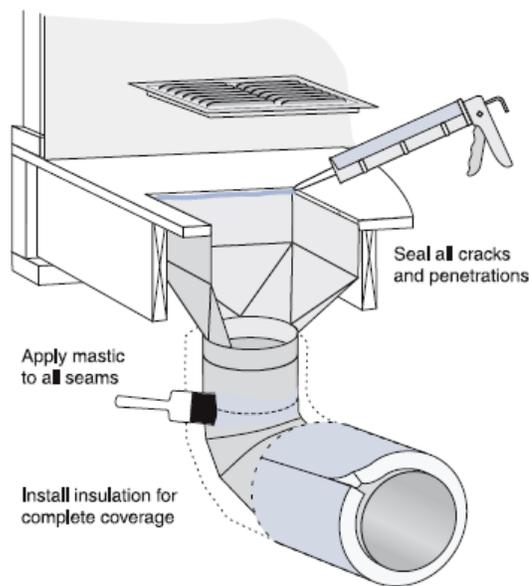

**Figure 14 Sealing Duct Boots & Connections<sup>7</sup>**

 **TIP:** When sealing register boots make sure to wait until the mastic is dry before re-installing the register grilles. If you don't, the grilles will be glued shut!

<sup>7</sup> Technology Fact Sheet: "Air Distribution System Installation And Sealing". March 2003. DOE/GO102003-0783

7. *Air Handler Cabinets and Refrigerant Lines.* Seal around refrigerant lines, condensate drains or any other penetrations coming out of the air handler cabinet or plenums. The air handler cabinet itself can be a major source of leakage during the duct leakage test. Make sure filter slots are well sealed. Seal all seams in the air handler cabinet and connections between the cabinet and the return and supply plenums.



## 2.4 Refrigerant

### 2.4.1 The orifice size must match the system:

- Fixed orifice metering devices must match the outdoor unit (when replacing or installing new systems)
- Piston-type metering devices: If the indoor coil has a different sized piston than the one on the outdoor unit, the indoor coil piston must be replaced with the correct size. When the installation is complete, attach the label that comes with the correct piston to the indoor coil.
- Capillary tube equipped systems must have matched indoor and outdoor coils.
- TXV metering device: must be properly sized to match the outdoor unit.

In a cooling system, the refrigerant leaves the condenser as a liquid and is pumped to the air conditioner metering device. The metering device meters the refrigerant only allowing a certain quantity to get past it. The metering device creates a pressure drop of the liquid refrigerant which causes the refrigerant to drop in temperature. The refrigerant is now cold and ready to enter the air conditioner evaporator coil.

TXV's (thermostatic expansion valves) will meter the refrigerant based on a calculated quantity of refrigerant needed to satisfy demand. For fixed metering devices such as bullet orifices, pistons, and capillary tubes, the same quantity of refrigerant is metered no matter the demand. This is the reason why TXV metering devices are used in air conditioner systems rated for higher efficiency<sup>8</sup>.

Fixed metering devices are typical on older systems that use R-22 refrigerant which is being phased out of use and is not used in new systems today. Older systems can be serviced and charged with R-22, but if either the outdoor or indoor coil of a system needs replacing, both components will have to be replaced so that the new R-410A refrigerant can be used.

#### Identifying Metering Devices

- **Fixed (Bullet) Orifice:** Only a technician will be able to locate and inspect this metering valve. Again, these systems are associated with R-22 refrigerant, therefore if a new system is being installed, this type of metering device would most likely not be used.
- **Piston:** There will be two piston metering valves on a system if it is a heat pump. Cooling only systems will have only one piston metering valve. The size of the piston orifice should be located on the nameplate on the equipment and will be listed in millimeters (mm).
- **Capillary Tube:** If you have access to the evaporator coil, you can identify a capillary tube as you will see numerous small diameter (0.02-0.09 inches) copper tubes running from a single distributor (connected to the liquid line) to the

---


<sup>8</sup> <http://highperformancehvac.com/how-air-conditioners-work#how-air-conditioners-work-metering-device>

various branches of the evaporator coil. If the technicians notes that the system has a capillary tube metering device, the indoor and outdoor coils must be matched either according to manufacturer's data, AHRI or matched coil capacities.



**Figure 15 Capillary Tube Metering Device**

- **TXV:** The most widely used metering devices are thermostatic expansion valves (TXV) followed by piston metering devices and capillary tubes. Most TXV's are external field mounted, so look for a bulb and capillary tube on the suction (large) line that feeds back to a valve in the liquid (small) line. The part number can be found on the TXV and the size can then be determined from the manufacturer's literature. Compare the capacity of the TXV to the capacity of the outdoor coil.

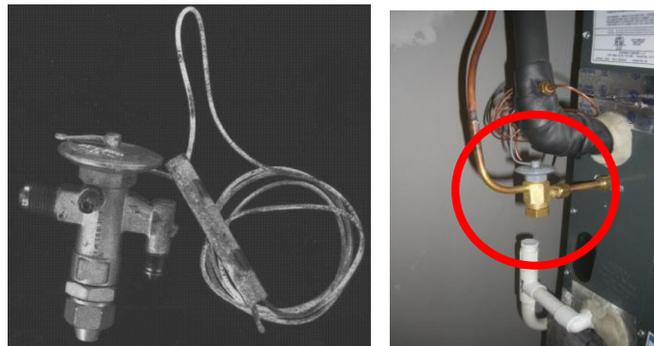

**Figure 16 TXV Metering Device<sup>9</sup>**

<sup>9</sup> <http://dnr.louisiana.gov/sec/execdiv/techasmt/ecep/hvac/h/h.htm>

- 2.4.2 Refrigerant lines and indoor coil must be purged with inert gas during brazing to prevent oxidation.

This item is the responsibility of the certified HVAC technician. The auditor should verify that the technician has checked this off on the Data Collection form.

- 2.4.3 New systems must be evacuated to 500 microns or less. Isolate the system from the vacuum pump and let it sit. The micron gauge should not rise more than 300 microns (or the manufacturer's specified limit, whichever is less) in 5 minutes above the initial vacuum level.

This procedure removes moisture from the system and ensures that there are no leaks. This item is the responsibility of the certified HVAC technician. The auditor should verify that the technician has checked this off on the Data Collection form.

- 2.4.4 Proper charge must be verified using the superheat or sub-cooling method. When weather conditions do not allow for proper AC testing (super-heat or sub-cooling), the charge may be “weighed in”. The charge must be calculated according to the manufacturer’s specifications.

Checking refrigerant charge is the responsibility of the HVAC technician. The auditor should verify that the information was completed for this section on the Data Collection Form. Verify that the correct test was performed based on the type of metering valve present. See section 2.4.1 for information on how to identify metering devices.

**IMPORTANT NOTES ON CHECKING REFRIGERANT CHARGE:**

- BEFORE charge can be tested, airflow across the coil MUST meet the manufacturer’s specifications. All airflow testing and adjustment MUST be conducted before testing the refrigerant charge.
- These tests CANNOT be performed on a heat pump in heat mode.
- The outside air temperature SHOULD be above 60°F

**Superheat Test**

This test is performed at the suction line (at the condenser) on units with fixed orifice, piston or capillary tube metering devices.

For an accurate superheat test, the following conditions should be met:

1. The technician must have tools that can measure dry bulb outdoor temperature, entering condenser coil temperature and wet bulb temperature of the return air at the air handler.
2. The test must be conducted with the system under a full load.
3. An accurate temperature measurement must be taken on the suction line near the service port. The pipe must be cleaned before taking the measurement.
4. The suction line pressure is measured at the compressor service port.
5. Using the suction line pressure, look up the saturation temperature from the manufacturer’s Pressure/Temperature chart. Figure 17 can be used for R-410A and R-22 if manufacturer literature is not available.
6. Superheat is the difference between the measured suction line temperature reading obtained in Step 3 immediately above, and the temperature obtained in the previous step. Determine if the superheat is within  $\pm 5^\circ\text{F}$  of the equipment manufacturer’s required superheat value for the condition.

NOTE: If the superheat is higher than the manufacturer’s specified range, refrigerant should be added. If the superheat is lower than the specified range, refrigerant will have to be removed. The test should be repeated after 15 minutes of adding or removing refrigerant.

°F	R-410A	R-22	°F	R-410A	R-22	°F	R-410A	R-22	°F	R-410A	R-22
-40	10.8	0.6	10	62.2	32.8	60	169.6	101.6	110	364.1	226.4
-39	11.5	1.0	11	63.7	33.8	61	172.5	103.5	111	369.1	229.6
-38	12.1	1.4	12	65.2	34.8	62	175.4	105.4	112	374.2	232.8
-37	12.8	1.8	13	66.8	35.8	63	178.4	107.3	113	379.4	236.1
-36	13.5	2.2	14	68.3	36.8	64	181.5	109.3	114	384.6	239.4
-35	14.2	2.6	15	69.9	37.8	65	184.5	111.2	115	389.9	242.8
-34	14.9	3.1	16	71.5	38.8	66	187.6	113.2	116	395.2	246.1
-33	15.6	3.5	17	73.2	39.9	67	190.7	115.3	117	400.5	249.5
-32	16.3	4.0	18	74.9	40.9	68	193.9	117.3	118	405.9	253.0
-31	17.1	4.5	19	76.6	42.0	69	197.1	119.4	119	411.4	256.5
-30	17.8	4.9	20	78.3	43.1	70	200.4	121.4	120	416.9	260.0
-29	18.6	5.4	21	80.0	44.2	71	203.6	123.5	121	422.5	263.5
-28	19.4	5.9	22	81.8	45.3	72	207.0	125.7	122	428.2	267.1
-27	20.2	6.4	23	83.6	46.5	73	210.3	127.8	123	433.9	270.7
-26	21.1	6.9	24	85.4	47.6	74	213.7	130.0	124	439.6	274.3
-25	21.9	7.4	25	87.2	48.8	75	217.1	132.2	125	445.4	278.0
-24	22.7	8.0	26	89.1	50.0	76	220.6	134.5	126	451.3	281.7
-23	23.6	8.5	27	91.0	51.2	77	224.1	136.7	127	457.3	285.4
-22	24.5	9.1	28	92.9	52.4	78	227.7	139.0	128	463.2	289.2
-21	25.4	9.6	29	94.9	53.7	79	231.3	141.3	129	469.3	293.0
-20	26.3	10.2	30	96.8	55.0	80	234.9	143.6	130	475.4	296.9
-19	27.2	10.8	31	98.8	56.2	81	238.6	146.0	131	481.6	300.8
-18	28.2	11.4	32	100.9	57.5	82	242.3	148.4	132	487.8	304.7
-17	29.2	12.0	33	102.9	58.8	83	246.0	150.8	133	494.1	308.7
-16	30.1	12.6	34	105.0	60.2	84	249.8	153.2	134	500.5	312.6
-15	31.1	13.2	35	107.1	61.5	85	253.7	155.7	135	506.9	316.7
-14	32.2	13.9	36	109.2	62.9	86	257.5	158.2	136	513.4	320.7
-13	33.2	14.5	37	111.4	64.3	87	261.4	160.7	137	520.0	324.8
-12	34.2	15.2	38	113.6	65.7	88	265.4	163.2	138	526.6	329.0
-11	35.3	15.9	39	115.8	67.1	89	269.4	165.8	139	533.3	333.2
-10	36.4	16.5	40	118.1	68.6	90	273.5	168.4	140	540.1	337.4
-9	37.5	17.2	41	120.3	70.0	91	277.6	171.0	141	547.0	341.6
-8	38.6	17.9	42	122.7	71.5	92	281.7	173.7	142	553.9	345.9
-7	39.8	18.7	43	125.0	73.0	93	285.9	176.4	143	560.9	350.3
-6	40.9	19.4	44	127.4	74.5	94	290.1	179.1	144	567.9	354.6
-5	42.1	20.1	45	129.8	76.1	95	294.4	181.8	145	575.1	359.0
-4	43.3	20.9	46	132.2	77.6	96	298.7	184.6	146	582.3	363.5
-3	44.5	21.7	47	134.7	79.2	97	303.0	187.4	147	589.6	368.0
-2	45.7	22.4	48	137.2	80.8	98	307.5	190.2	148	596.9	372.5
-1	47.0	23.2	49	139.7	82.4	99	311.9	193.0	149	604.4	377.1
0	48.3	24.0	50	142.2	84.1	100	316.4	195.9	150	611.9	381.7
1	49.6	24.9	51	144.8	85.7	101	321.0	198.8			
2	50.9	25.7	52	147.4	87.4	102	325.6	201.8			
3	52.2	26.5	53	150.1	89.1	103	330.2	204.7			
4	53.6	27.4	54	152.8	90.8	104	334.9	207.7			
5	55.0	28.3	55	155.5	92.6	105	339.6	210.8			
6	56.3	29.2	56	158.2	94.4	106	344.4	213.8			
7	57.8	30.1	57	161.0	96.1	107	349.3	216.9			
8	59.2	31.0	58	163.8	98.0	108	354.2	220.0			
9	60.7	31.9	59	166.7	99.8	109	359.1	223.2			

Source: Honeywell. The above data, including recommendations for application and use of R-410A (Genetron® AZ-20®) are available at <http://www.genetron.com>.

**Figure 17 Pressure/Temperature Chart for R-410A and R-22 Refrigerants.**

**Subcool**

This test is done at the condenser outlet on the systems equipped with a thermostatic expansion valve (TXV). The degrees F subcooling is equal to the condensing saturation temperature converted from the pressure reading minus the measured liquid line temperature. The following procedure is should be used for accurate results:

1. An accurate temperature measurement must be taken on the liquid line as close to the connection at the condenser as possible. The pipe must be cleaned before taking the measurement.
2. The liquid pressure should be converted using a vapor saturation temperature chart.
3. Subcooling is the difference between the measured temperature readings in the liquid line and the temperature obtained by the pressure conversion. Determine if the subcooling is within 3°F of the equipment manufacturer's optimal number.

NOTE: If the subcooling is lower than the manufacturer's specified range, refrigerant should be added. If the subcooling is higher than the specified range, refrigerant will have to be removed. The test should be repeated after 15 minutes of adding or removing refrigerant.

## 2.5 Controls

- 2.5.1 Heat pump controls shall stage the compressor based heating first, followed by one or more stages of back-up heating. The first stage of heating shall not include electric resistance heating.

This is the responsibility of the HVAC technician. The technician should verify that the first stage of heating does not include electric resistance heating by creating a call for heat and using an electric meter to verify that the resistance heater does not activate in the first stage. The auditor should verify that the information was completed on the Data Collection Form.

- 2.5.2 If the rated SEER or HSPF for the unit is dependent on a particular option (Thermostatic Expansion Valve and/or Time Delay Relay) that option must be installed.

Visual verification of TXV's can be performed by the auditor. See section 2.4.1 for information on how to identify metering devices.

To determine if a Time Delay Relay was installed, the auditor can turn down the thermostat below the room temperature to force the cooling system on. Once the system is running, turn the thermostat back up again to a setting higher than the actual room temperature. If the air handler fan runs for a minute or two after this is done, a time delay relay has been installed.

## 2.6 Commissioning

- 2.6.1 Newly installed AC and heat pump systems must be run through a heating and/or cooling cycle as noted in **2.2.1, 2.2.2, 2.2.3, 2.3.1, 2.4.4, 2.5.1, and 3.1.1** to verify proper performance of airflow, charge, controls, room pressures, and delivery of heating/cooling to the living space. These parameters can be verified singly or in groups.

See the applicable sections for more information on how to comply with those requirements.

## 3 Commissioning

---

### 3.1 Airflow

- 3.1.1 New ducted distribution systems require register airflows to be measured and verified. The system shall deliver +/- 20% of design airflows for each conditioned room. Deviations from design criteria greater than 20% must be corrected.

The designed air flow requirements should be input into the Airflow & Room-to-Room Pressure Form (see Appendix) before arriving on site. The airflow at each register must be measured and recorded. Compliance is met if the tested airflow is within +/-20% of the design airflow.

To minimize potential “whistling” sounds, it is recommended to adjust inline dampers, if available, rather than the supply registers dampers.

The HVAC QI specification requires that balancing be done with all doors closed to ensure there is supply and return airflow at those times.



#### Flow Hood

Make sure your equipment is rated for the full range of flows you will encounter. Flow Hood manufacturer’s directions must be followed. For example a temperature probe may need to be installed, or a conversion table may need to be used for accurate readings when the supply air is heated.

#### Anemometer

When performing a traverse with an anemometer, the auditor/technician needs to consider:

- Some corrections will need to be made to the final answer if the temperature is below 60°F or above 80°F. (see appendix)
- Several types of meters can be used. For fast and accurate results, select a meter that reads in feet per minute and corrects for altitude and horizontal positioning.

This calculation should be done for each room. There is a Register Flow & Room-to-Room Pressure Form in the appendix for recording design and measured air flows. It can be used to verify compliance with this item and 2.1.6.

Example:

Airflows for the home at 555 Sample Street were measured at each register and recorded on the Register Flow & Room-to-Room Pressure Form (see below). Is this system in compliance with item 3.1.1 of BPI’s technical standard?

Register Flow Summary Sheet					
Project Address:		555 Sample Street			
HVAC Company:		ABC Plumbing & Heating			
Technician:		Pat Smith	System Install Date:		6/1/2010
Auditor:		Carol Jones	Audit Date:		6/10/2010
Tool Used:		XXX Airflow Device	Model Number:		zzz-xxx
Room/Grill Number	Design Load CFM <sup>1</sup>	Duct Design CFM <sup>2</sup>	% of Design <sup>3</sup>	Measured CFM	% of Design <sup>4</sup>
Living Room	286	280	-2%	320	
Dining	261	250	-4%	220	
Den	156	150	-4%	175	
Kitchen	148	150	1%	115	
Hall	112	100	-12%	100	
Closet 2	0	0	0%	0	

Answer:

For each room, calculate the % deviation from the design flow by dividing the measured air flow by the design airflow, subtracting that number from 1 and multiplying the result by 100:

$$1 - (\text{Measured Airflow} / \text{Design Airflow}) \times 100 = \% \text{ of design}$$

The results for each room are located in the table below in the far right column.

Register Flow Summary Sheet					
Project Address:		555 Sample Street			
HVAC Company:		ABC Plumbing & Heating			
Technician:		Pat Smith	System Install Date:		6/1/2010
Auditor:		Carol Jones	Audit Date:		6/10/2010
Tool Used:		XXX Airflow Device	Model Number:		zzz-xxx
Room/Grill Number	Design Load CFM <sup>1</sup>	Duct Design CFM <sup>2</sup>	% of Design <sup>3</sup>	Measured CFM	% of Design <sup>4</sup>
Living Room	286	280	-2%	320	-12%
Dining	261	250	-4%	220	16%
Den	156	150	-4%	175	-12%
Kitchen	148	150	1%	115	22%
Hall	112	100	-12%	100	11%
Closet 2	0	0	0%	0	0%

The airflow in the Kitchen is not within 20% of the design flow. Therefore, the home is not in compliance.

## 3.2 Commissioning

- 3.2.2 Duct tightness for newly installed duct systems must meet or exceed the requirements set forth in the EPA standards for Energy Star Ducts. The sum of supply and return leakage measured at 25 Pascals of pressure shall be no more than 10% of the measured system airflow. (Example: With a measured 1,200 CFM system airflow, the total duct leakage may not exceed 120 CFM25.)

NOTE: If a local program has stricter requirements than those listed above, the stricter values shall apply. Clark County has adopted the Home Performance Specifications for Warm Climates which require duct leakage levels of no more than 6% of the total airflow or a reduction of 40% of the original value.

This procedure describes how to measure duct leakage to outside using a combination of air leakage and duct leakage testing equipment. For specific instructions regarding proper use of this equipment, it is recommended that technicians refer to the manufacturer's users manuals.

Before beginning to set up for testing, a visual inspection of the system should be completed to make sure there are no reasons that the test should not be run.

### Duct Leakage to Outside Testing Procedure:

1. Configure the house for an air leakage test (see section 2.1.5 for information on conducting a blower door test)
2. It may also be helpful to choose a door in close proximity to the furnace/AC air handler as you may find yourself running between the two fans to adjust pressures during the test.
3. If a pressurization test is being used, and the blower door is only being used to maintain a 25 Pascal house pressure during the duct leakage test, the fan may be installed facing out and the reverse switch may be used to blow air into the house. This is somewhat easier than working with the fan turned around and facing into the house.
4. Determine if the air handler is inside or outside the conditioned space.
  - a. If the air handler is "outside", make sure the door between the zone and the living space is securely shut.
  - b. If the air handler is "inside", make sure any doors between the zone and the living space is open.
5. Remove the system air filter. In most cases, this will be in a filter slot near the air handler on the return side. Some central-return systems may have filters mounted in the register grill. Some filters are located inside the air handler cabinet. (If the filter is dirty, remind the homeowner to clean or replace it.)
6. Set up the duct leakage testing equipment
  - a. Select an appropriate location.

- i. The air handler cabinet may be the most convenient location and will ensure limited restrictions to the testing equipment airflow.
    - ii. If the duct leakage testing equipment cannot be set up on the air handler, a return register may be used. This works best for central-return systems. If they system has multiple returns, choose the register closest to the air handler.
  - b. Select a testing configuration: pressurization or depressurization
    - i. Pressurization testing is easier to set up and is usually preferable.
    - ii. If depressurization is chosen, make sure to follow the manufacturer's instructions for proper setup including use of the flow conditioner and hose connections.
  - c. Set up the pressure hoses
    - i. Drill a ¼" hole in a supply duct near the air handler and install a static pressure probe pointing into the direction of the airflow. Ideally, duct pressure measurements should be taken in a location free of turbulence from connectors, elbows, etc. Look for a straight run of duct approximately 12" downstream of the plenum for best results. If this is not possible, pressures may be taken in the plenum.
    - ii. Connect the supply hose to the input tap of Channel A of the manometer. If the supply pressure measurement is being taken from a space "outside" the conditioned area, an additional hose must be run to the conditioned space and attached to the Channel A reference tap on the manometer. If the supply pressure measurement is being taken from "inside" the conditioned area, leave the reference tap open.
    - iii. Set up a third hose connecting the duct leakage testing equipment fan to the input tap of Channel B of the manometer. Leave the Channel B reference tap open.
7. Seal all supply and return registers. Use masking tape or duct mask and completely seal all registers in the duct system.
8. Open unconditioned zones to outside as much as possible. If the air handler is located outside the conditioned space, try to open the zone to outside as much as possible (open attic vents, basement windows, bulkhead doors, etc.).
9. Using the blower door, pressurize the house to 25 Pascals<sup>10</sup> with reference to (WRT) outside. Always turn the fan up slowly to avoid sudden changes in pressure. Leave the blower door fan running.
  - a. It may not be possible to reach 25 Pascals of pressure in very leaky or very large houses. If this is the case, use the highest test pressure possible and adjust the final duct leakage cfm to 25 Pascals by using the chart provided by the duct leakage testing equipment manufacturer.

---

<sup>10</sup> From this point forward, the procedure assumes a pressurization test is being done. Refer to the user's manual for complete instructions for conducting a depressurization test.

👉 TIP: If cold ashes are present in a fireplace, cover them with wet newspaper and use some logs or fireplace tools to weigh it down while running the blower door.

☠ SAFETY ISSUE: NEVER run a blower door in a house with a wood fire burning. Even a few hot embers can re-ignite when subject to air

10. Using the duct leakage testing equipment fan, pressurize the duct system until the pressure in the supply duct is 0 WRT the conditioned space. If the ducts are not very leaky to outside, it may be necessary to use a low flow ring. If a fan pressure of less than 10 Pascals is needed to bring the supply duct pressure to zero, then add a low flow ring. Once that pressure is stable, it is a good idea to double check that the blower door is still at 25 Pascals. When you are sure both pressures are stable, take the duct leakage testing equipment pressure and flow readings.
11. Record the house pressure, testing equipment fan pressure and ring configuration.
12. Record the testing equipment airflow. This is your duct leakage to outside.
13. Disassemble the equipment.
14. Return the home to its original condition.

## 4 Service & Repair

---

Several items in this section are similar or identical to items already covered. Where that is the case, the applicable section has been referenced.

### 4.1 Duct Systems

- 4.1.1 Sheet metal and flexible ductwork shall be mechanically fastened and sealed at all connections. Sealing shall use duct mastic or similar product designed for sealing ducts. Duct tape is not an allowable duct sealing material. UL standard (UL 181, UL 181A, or UL 181B) duct tape may be used only at the plenum connection to the air handler cabinet.

See section 2.3.3 for more information.

- 4.1.2 Filter slots must be tightly covered and the cover must be easily removed for cleaning and/or replacement.

See section 2.3.2 for more information

## 4.2 Refrigerant

- 4.2.1 Refrigerant charge may not be added to a system with leaks. If refrigerant was previously added and unit has undercharge, the system must be tested for leaks following established protocols for leak detection. Leaks must be repaired or the client must be informed that the system cannot be charged.

Leaks can be detected in a couple of different ways. First, a fluorescent dye can be injected into the refrigerant, and with the help of a special infrared camera, leaks can be easily detected. Second, electronic leak detection meters can be used similar to that used to find gas leaks. These meters are not very effective on R-410A refrigerant.

Leak detection is the responsibility of the HVAC technician. The auditor should verify that the proper information was input on the Data Collection Form.

- 4.2.2 Refrigerant charge corrections must be verified using the appropriate charge measurement method (superheat or sub-cooling) Air conditioner or heat pump airflow must be within the design parameters of the manufacturer's specifications with a minimum of 325 CFM/Ton before proceeding with refrigerant charge corrections based on the results of the appropriate charging tests. If airflow adjustments are made the refrigerant charge test must be rerun.

See section 2.4.1 & 2.4.4 for information on how to determine which tests should be used.


The logo consists of the letters 'HPS' in a white, sans-serif font, centered within a black square with a thin white border.

According to the Home Performance Specifications for Warm Climates, design airflows should be a minimum of 400 cfm/ton before proceeding with refrigerant charge corrections.

### 4.3 Airflow

#### 4.3.1 System airflow must be measured and

- Measured heat pump airflow should be between 375-450 CFM/Ton, or within manufacturer's specifications when measured over a dry coil (*i.e.* tested in heating mode.)
- Measured air conditioner airflow should be at least 350 CFM/Ton unless the manufacturer specifies a lower airflow for the local design condition, when measured over a wet coil (*i.e.* tested in cooling mode after a minimum of 15 minutes of run time.)



According to the Home Performance Specifications for Warm Climates, design airflows should be between 400 to 480 cfm/ton for locations like Las Vegas.

See section 2.2.1 for more information on determining system airflow and meeting this requirement.

- 4.3.2 For existing systems: The contractor must attempt to bring the airflow within the ranges set in **4.3.1** by opening registers, opening dampers, changing blower speed, replacing filters, and removing obvious easily repaired kinks in flex duct systems. If the above repairs do not bring the unit into compliance, the contractor shall inform the customer that indoor coil cleaning or duct system revisions are necessary.

See section 2.2.3.

- 4.3.3 If repairs are made that effect airflow, the system airflow shall be measured before and after repairs are completed.

See section 2.2.1 for directions on measuring airflow.

## 5 Diagnostic Tests

---

Several items in this section are similar or identical to items already covered. Where that is the case, the applicable section has been referenced.

### 5.1 Electrical

5.1.1 Existing wiring systems must be inspected for safe installation and compliance with applicable codes. This inspection should include, but is not limited to:

- Checking for obvious loose connections
- Visual inspection of contacts to verify good condition (no pitting, etc.)
- Properly sized wire gauge as required by the circuit amp draw

See item 1.3.2 for more detail on which electrical components should be inspected and tested.

5.1.2 Voltage drop across contacts and relays may not occur. If a voltage drop is measured, the source must be located and corrected.

Checking voltage drop is the responsibility of the HVAC technician. The auditor should verify that the proper information was input on the Data Collection Form.

## **5.2 Airflow**

- 5.2.1 System airflow may be measured using a metered and calibrated pressurization device, a metered and calibrated flow plate, or a flow capture hood designed for the flow range anticipated.

See section 2.2.1 for information on measuring airflow.

## **5.3 Duct Systems**

- 5.3.1 Pre- and Post-installation duct leakage shall be measured any time that duct sealing is part of the work-scope to verify the success of the installation.

See section 3.2.2 for information on determining duct leakage.

- 5.3.2 When quantifying duct leakage, a measurement system that includes a metered and calibrated duct pressurization device shall be used.

See section 3.2.2 for information on determining duct leakage.

## **5.4 Refrigerant**

- 5.4.1 Refrigerant charge may be measured using the following methods:

- Use sub-cooling method for TXV equipped systems
- Use superheat method for non-TXV equipped systems  
(Alternative manufacturer-specific procedures may be allowable. Submit alternative procedures to BPI for review and approval.) If airflow is changed, the refrigerant charge must be retested.

See section 2.4.1 and 2.4.4 for procedures for measuring refrigerant charge.

## References

---

Air Conditioning Contractors of America (ACCA), Plumbing-Heating-Cooling-Contractors-National Association Educational Foundation, Refrigeration Service Engineers Society. 2009. "HVACR 101". Delmar CENGAGE Learning. Clifton Park, NY.

Air Conditioning Contractors of America (ACCA), Plumbing-Heating-Cooling-Contractors-National Association Educational Foundation, Refrigeration Service Engineers Society. 2009. "HVACR 201". Delmar CENGAGE Learning. Clifton Park, NY.

Air Conditioning Contractors of America (ACCA), Plumbing-Heating-Cooling-Contractors-National Association Educational Foundation, Refrigeration Service Engineers Society. 2009. "HVACR 301". Delmar CENGAGE Learning. Clifton Park, NY.

Air Conditioning Contractors of America (ACCA). 2007. "ACCA Standard 5: HVAC Quality Installation Specification". ACCA, Arlington, VA.

Air Conditioning Contractors of America (ACCA). 2008. "Technicians Guide for Quality Installations". ACCA, Arlington, VA.

Air Conditioning Contractors of America (ACCA). 2009. "ACCA Standard 9: HVAC Quality Installation Verification Protocols". ACCA, Arlington, VA.

Air Conditioning Contractors of America (ACCA). 2009. "Manual D, Residential Duct Systems". Third Edition, V. 1.00. ACCA, Arlington, VA.

Building Performance Institute, Inc (BPI). 2003. "Technical Standards for the Air Conditioning and Heat Pump Professional". BPI. Malta, NY.

Consortium for Advanced Residential Buildings (CARB), Steven Winter Associates, Inc. 2010 "Designing Forced-Air HVAC Systems". <http://www.carb-swa.com/index.html>.

Consortium for Advanced Residential Buildings (CARB), Steven Winter Associates, Inc. 2010 "Why Right-Size?". <http://www.carb-swa.com/index.html>.

Krigger, J., Dorsi, C. 2006. "Saturn Mechanical Systems Field Guide". Saturn Resource Management, Inc. Helena, MT.

Krigger, J., Dorsi, C. 2008. "Home Performance Specifications for Warm Climates". Saturn Resource Management, Inc. Helena, MT.

Rutkowksi, H. PE. 2004. "Manual S, Residential Equipment Selection". Air Conditioning Contractors of America (ACCA), Arlington, VA.

Rutkowksi, H. PE. 2006. "Manual J, Residential Load Calculations". Eighth Edition, V. 2.00. Air Conditioning Contractors of America (ACCA), Arlington, VA.



## Appendix A. Field Checklists

---

## Appendix B. Auditor's Equipment List

---

### Tools

- Compass
- Multi-bit screwdriver
- Nut driver set
- Utility knife
- Tape measure – 30'
- Cordless drill w/charger & 2 batteries
- Drill bit set

### Testing Equipment

- Blower Door
- Duct Blaster
- Extra manometer & hoses
- Balometer
- Gas leak detection meter
- Carbon monoxide detector
- Infrared camera (optional)

### Testing Supplies

- Duct mask
- Metal tape - UL
- Masking tape – 2" wide
- Duct tape
- Smoke puffers

### Personal Protection

- Dust masks – std. white mask
- Safety glasses
- Small first-aid kit
- Full-length mesh suits
- Cloth gloves
- Cloth booties
- Sleeve extensions

### Cleaning Supplies

- Trash bags – 13 gal.
- Dust pan & brush
- Swiffer-type sweeper
- Sweeper refills – dry type


### Miscellaneous

- Flashlight
- Extension cord – 25'
- 3-prong outlet adapters
- Ladder
- First aid kit

### ACCA Briefing

By Glenn C. Hourahan, PE  
Hank T. Rutkowski, PE

## Are YOU Using MJ8™ Correctly?

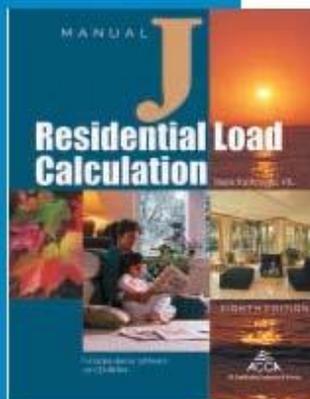

In an October 2008 article of *Contracting Business Magazine*, Stan Johnson asked: Why Aren't YOU Using Manual J? He observed that the Eighth Edition of Manual J8 (MJ8™) provided far greater capabilities/abilities than the Seventh Edition (MJ7™). He noted that contractors using MJ8 will receive correct heat loss and heat gains if the MJ8 guidelines are followed. This article builds on Stan Johnson's essay and provides specific do's and don'ts to ensure your heat loss and heat gain estimates are done per Manual J guidelines.

### MJ8 – MJ7 Load Differences

It should be noted that there are significant differences between the two procedures. Some of these may cause the MJ8 load to be larger, and some of these may cause the MJ8 load to be smaller than the load obtained from MJ7. Before and since MJ8 was published, ACCA has investigated the differences between MJ7 and MJ8. The re-occurring conclusion is that for a conventional MJ7 type dwelling (generic fenestration, common construction, no special features), the resulting envelope loads (i.e., windows, doors, ceilings, foundation, walls, infiltration, etc.) are essentially the same from either procedure. Hence, when the ducts are located in the conditioned space, MJ7 and MJ8 provide equivalent load estimates (generally, within ± 5%) when equivalent assumptions are used.

However, when the ducts are in an unconditioned space (i.e., in a hot, vented attic) the MJ7 and MJ8 loads may vary quite a bit. In the worst case, depending on design elements, the MJ8 duct loads can be as much

as a full ton higher, or even more if the ducts are in very poor condition. The following considerations greatly impact MJ8 duct heat gain/loss loads:

- Tightness of the supply and return ducts (i.e., how well "sealed" or how much "leaky")
  - Effective level of insulation around the ducts
  - The amount of duct surface area actually in the unconditioned space
  - The temperature in the unconditioned space
- Sensitivities to these factors were never present in MJ7, and hence, "the apparent load" produced by MJ8 appears larger. Yet, research clearly demonstrates that duct system efficiency/effectiveness is the single biggest issue as far as energy use is concerned (as well as health and comfort!). MJ7 gives a free pass to inefficient duct systems. MJ8 appropriately penalizes poor duct construction. On the other hand, for well-sealed, well-insulated, well-designed ducts, MJ8 produces loads that are comparable – or even smaller – than those derived from MJ7.

### Old Habits Will Not Work with MJ8

In addition to the dust considerations, care must be exercised in the assumptions used when performing a Manual J calculation. If the input assumptions are not carefully selected, either Manual J procedure will produce heat loss and heat gain estimates that result in over-sized heating and air conditioning systems. This potential for over-sizing is not due to errors in the Manual J databases and calculation procedures, but rather to system designers that have a habit of weaving a collection of worst-case assumptions into their load analysis. Some examples of such practices include:

- Manipulating the outdoor design temperature: Although Manual J calls for use of a specific

summer design temperature, some designers arbitrarily increase the outdoor design temperature by five degrees (or to some other unjustified maximum observed temperature). Manual J stipulates that the listed summer design temperature for the specific location is to be used for the heat gain estimate. This also applies to the outdoor heating design temperature and the indoor design temperatures.

- Ignoring internal shade devices: For unoccupied (or "spec") homes, system designers almost always assume the worst case for window shading (none) and site shading (none) during sizing. This assumption can unnecessarily add one-half ton of installed cooling capacity to a 2,500 ft<sup>2</sup> home. MJ8 stipulates that drapes and blinds be assumed unless there is specific information to the contrary.
- Not evaluating overhang benefit: System designers often skip the shade-by-overhang adjustment for window and glass door gain because it seems like a minor detail and because it adds complexity to the procedure. In fact it is not a minor detail; in many cases the extra effort translates to a significant reduction in the fenestration gain and smaller cooling equipment.
- Intermittent fans equated to engineered ventilation: If bathroom and kitchen fans are evaluated as engineered ventilation systems, excessive (and fibrous) loads are added to the heat gain and heat loss estimates. Both editions of Manual J stipulate that such fans be excluded from the load estimating procedure.
- Envelopes and ducts: When using MJ8, it is particularly important to consider duct leakages separate from envelope infiltration. Many system designers assume leaky ducts are equivalent to leaky envelopes (or infiltration loads),

ACCA Briefings are written by members of the ACCA staff on issues of interest to contractor members.

Glenn Hourahan is ACCA Vice President for Research and Technology. Hank Rutkowski authored MJ8™.

range from less than 500 ft<sup>2</sup>/ton to more than 1,200 ft<sup>2</sup>/ton. Efficient single-family detached homes with a normal amount of well-distributed glass typically fall in the 700 to 1,200 ft<sup>2</sup>/ton range. Limited exposure dwellings with concentrated glass (that produces a time-of-day peak) may fall in the 500 to 800 ft<sup>2</sup>/ton range. Homes with exceptional features can be all over the map in this regard. Just rotating a home on the site can change the ratio by 100 to 400 ft<sup>2</sup>/ton.

Comfort system performance is only as good as the accuracy of the heat-loss/heat-gain estimate. Efforts to "do just the load" to provide a "safety factor" or to produce a solution that is compatible with the "I have been doing it this way for 30 years" syndrome are forbidden.

#### Guidance When Using Software for Manual J Calculations

The number of input responses required by any particular third-party software package is an indication of the sensitivities and capabilities of the program and/or the number of defaults built into the program. Sensitivity is reduced when MJB options are replaced by nonadjustable defaults. Sensitivity is maintained by adjustable defaults. For example, a software program could:

- Default to a procedure that uses peak-hour values for fenestration gain. (Early versions of some MJB programs had such a default or switched to the peak-hour solution when adequate exposure diversity was not maintained for windows. Later releases (or updates) of some software replaced the peak-hour toggle with an exclusion adjustment. Be sure that the program you are using is not using a peak-hour toggle to estimate fenestration gain.)
- Default to generic fenestration with no internal shade, no overhang, and/or no options to use other scenarios.
- Default to a user-defined scenario for fenestration.
- Require user input for all detail relating to each piece of fenestration.


An unabridged list of the detail required for a pure application of the

complete MJB procedure is too large to present here. Such information can be gleaned by scrutinizing the worksheets in Appendix 2 of MJB. Much of this is just common sense—if the software does not ask about a specific detail, it has made a decision for you. There is nothing wrong with this, providing you know about it and agree with the decision.

#### Conclusion

ACCIA recommends that rigorous load calculations—grounded in

sound, up-to-date building science—be undertaken with proper assumptions, correct methodology and no addition of safety factors. Properly observing the above requirements will produce accurate Manual J loads. Once you know the sensible and latent loads from Manual J, consult ACCIA's Manual S<sup>®</sup> for specific guidance on how to properly select the equipment that satisfies the application. ACCIA has long suggested that it is better to undersize equipment by 10% than oversize it by 10%. ■

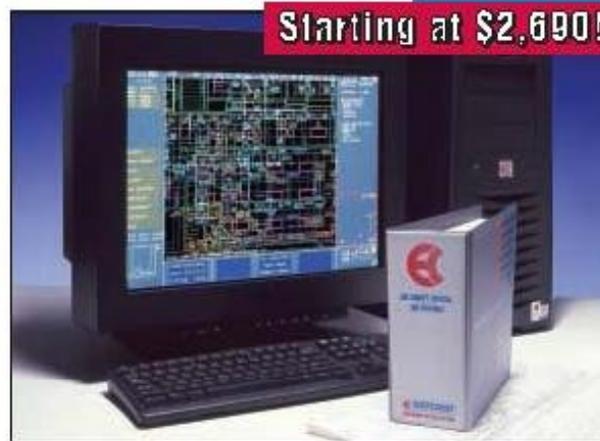

### 1. Design 2. Coordinate 3. Pick-off 4. Download

It's as easy as 1,2,3,4!

Right from the start our 3D CADm makes it easy by importing and exporting 3D drawings from AutoCAD. EC-CAD easily draws 3D Architectural, HVAC, and Piping systems. EC-CAD is not an "Add-On" package like other systems in the market place. That means you only need to learn one system and you don't need to buy additional software before you can produce high quality drawings that are ready for fabrication.

EastCoast CAD/CAM's 3D EC-CAD and MAKEIt software are used in over 1200 shops worldwide and are recognized as the best in the industry.



Here are a few reasons why:

- 50% fewer keystrokes than AutoCAD
- Complete solution for Architectural, HVAC and Piping
- Designed for contractors by contractors
- Designed to be user friendly
- Written in trade terminology
- Compatible with other industry software
- Designed for fabrication processes
- Creates true 3D presentation and construction drawings
- Easily handles change orders
- True object, user specified collision checking
- Quick, automatic cross sections and details
- Draws with elevations not Z coordinates
- Draws to your shop standards
- Automatic piece numbering
- Preloaded database of thousands of HVAC, plumbing, and process piping elements

Learn how our customers—shops large and small—are saving time and money with EC-CAD, call (800) 334-2977 or visit us on the web at [www.eccadcam.com](http://www.eccadcam.com)

and then increase the infiltration air changes per hour (ACH) estimate to compensate for leaky ducts. This practice is equivalent to double counting leakage that is already factored into the MJ8 duct tables. In MJ8 – and in actual practice – the leakage of the envelope and the duct system are independent of each other. They can both be tight or leaky, or one can be tight and the other can be leaky; thus, they must be evaluated separately. For MJ8, Table 5 evaluates the envelope leakage and the duct leakage effect is included in the Table 7 duct load factors.

- **Using a code ventilation rate as the infiltration ACH value:** ACCA has found that code fresh air requirements (such as 0.35 ACH) are being incorrectly used as default infiltration rates without considering the actual tightness of the construction. Additionally, ACCA notes that some system designers habitually assume leaky construction without consideration of specified or observed efforts to provide efficient construction. [Ideally, duct and blower door test results should be used to obtain actual performance values and to establish track record for individual builders and duct system installers. Such tests are not always possible, but unless there is evidence to the contrary, the builder's plans and specifications deserve the benefit of the doubt as far as tightness is concerned.]

### Guidance for Undertaking MJ8 Calculations

Manual J is an engineering tool that has an inherent and appropriate factor of safety. Any attempt to add other safety factors or to manipulate the procedure may result in unacceptable performance, especially at part load. The following items, noted in Manual J, are highlighted for use by all practitioners:

#### MJ8 Dos (Mandatory Requirements)

- Verify all construction details prior to performing Manual J calculations.
- Use the outdoor design conditions recommended by Table 1 of MJ8, unless superceded by local code.
- Use indoor conditions that are

compatible with the ASHRAE comfort chart (i.e., the default conditions recommended by Manual J), unless superceded by local code:

- The recommended indoor drybulb temperatures are 70°F for heating and 75°F for cooling.
- For wet-coil climates (positive values for Table 1 Grains), the recommended indoor relative humidity (RH) is 50% for cooling.
- For dry-coil climates (zero or negative values for Table 1 Grains), the recommended indoor RH is 45% for cooling.

#### ● Specific duct considerations:

- Take full credit for duct system sealing and insulation when such efforts are confidently anticipated or certifiable.
  - Use the "sealed" scenario for ducts that are reasonably sealed.
  - If the duct sealing work is not so great, seal the ducts and then use the sealed table (use the unsealed table to show why the sealing work is required). [This is a great selling tool for fixing the ducts. Putting in the properly sized (smaller) equipment will generally leave enough money to seal the ducts ... and still leave you looking more price competitive.]
- Match location as close as possible when selecting a duct load table. [For attic systems, consider venting, roofing material, roof color and use of a radiant barrier. For closed crawlspaces, the table-choice depends on the crawlspace wall insulation. See MJ8, page T7-1 for a list of choices.]
- Match duct system geometry.
  - Radial and spider systems have less surface area than extended plenum and trunk and branch systems.
  - Be sure to use the adjustment factor (see MJ8, Worksheet G) for the exposed duct surface area when the actual duct system has less exposed area than the Table 7 scenario used for the duct load estimate. [Table 7 duct systems have multiple returns that do not flow more than 400 CFM of air per return. The surface area correction for a system that has one large return right at the air-handler is approximately 0.50. Such adjustment multipliers range between 0.50 and 0.90 and must

be defensible. See MJ8, Page A7-5 and A7-6.]

- Use the appropriate duct wall insulation correction if the R-value of the insulation is not R-6.
- In general, take full credit for the rated (or tested) performance of glazing assemblies, construction materials and construction features.
- Take full credit for insulation R-values:
  - As specified for new construction.
  - As installed (verify the installation conforms to methods and materials protocols).
  - As tested (see quality control programs for new construction, investigate existing construction)
- Take full credit for documented window, glass door and skylight U-values and SHGC values
  - For generic fenestration, use the Appendix 10 data provided by MJ8.
  - For NFRC fenestration, use the Table 3D-1 procedures provided by MJ8.
- Take credit for bug screens when such devices are installed or specified.
- Take credit for internal shade (per MJ8 defaults and protocols, and Table 3D-4). Windows and glass doors shall be shaded by a medium blind. However, internal shades are not applicable for purpose-built day-lighting windows.
- Take credit for overhangs (per MJ8 defaults and protocols, and Table 3E-1). The overhang adjustment shall be applied to all windows and glass doors, including purpose-built day-lighting windows.
- Consider orientation of the structure on the site.
  - Use the actual orientation whenever possible.
  - Use "best case/worst case" load estimates for cookie-cutter designs that may have varying site-orientations when built.
- Take full credit for tightness of the envelope construction.
  - As specified by builder or code.
  - As installed (verify the installation conforms to methods and materials protocols).
  - As tested (see quality control programs for new construction, investigate existing construction).
- Use a plausible estimate for the internal gain. Base such decisions on normal day-to-day and time of-

## ACCA Training Schedule

### Residential EPIC (Educational Program for Instructor Certification) in Systems Design

May 17-20 (Baltimore, MD)  
November 16-19 (Orlando, FL)

### ACCA Contractor Training Series: Fundamentals of Load Calculation and Systems Design

September 20-22 (New Hudson, MI—near Detroit)  
September 28-30 (Cincinnati, OH)  
October 5-7 (Dallas, TX)  
October 26-28 (Houston, TX)  
November 9-11 (Charlotte, NC)

For more information on these courses and to register, visit ACCA online at [www.acca.org/register](http://www.acca.org/register) or call Chris Hoelzel at 703-824-8851.

day occupancies, activities and events.

- If a code or regulation does not mandate a fresh air requirement, use MJ8, Table 8 procedures to determine the outdoor air requirement for the dwelling.
- Use MJ8 procedures to evaluate the
  - Infiltration load
  - Ventilation load
- If unknown, assume 500 watts for the indoor blower motor.
- Sit down with your customers or clients and educate them on these issues.

### MJE Don'ts (Mandatory Requirements)

- Do not use Manual J for:
  - Any type of commercial application,
  - Large multi-family buildings or residential high-rise structures,
  - A room or space containing an indoor swimming pool or hot tub,
  - Earth-born or earth-covered dwellings,
  - Solar homes that have passive or active features.

- Do not design for record-breaking weather conditions.
- Do not add a "safety factor" to the Table 1 design conditions.
- Do not design for abnormally low or high indoor temperatures or humidity conditions (unless there is a certified medical reason for doing so).
- Do not arbitrarily assume that ducts are unsealed (i.e., assume that they are leaky).
- Do not assume that there will be no internal shade on ordinary windows and glass doors (bare glass is an acceptable assumption for glass specifically installed for day-lighting).
- Do not fail to take credit for overhangs.
- Do not assume that the load for the worst-case site orientation can be used for other orientations.
- Do not reduce known ceiling, wall or floor R-values "just to be safe."
- Do not fail to give full credit for the builder's effort to produce a tight envelope.
- If a local code specifies a fresh air requirement (typically an air change per hour value), do not use the code ventilation requirement as the infiltration rate.
- Do not use internal load assumptions that cannot be defended.
  - Do not add extra occupancy loads for "entertaining groups of people."
  - Do not add extra internal loads for special events.
  - Do not make worst case "everything is going full blast" assumptions about internal loads.
- Do not fail to give full credit for efforts to provide tight, properly insulated ducts.
- Do not apply safety factors during any stage of the load calculation process.
- Do not apply a safety factor to the final answer or to the equipment selection procedure.

### Prohibited Practices

Do not use "rules-of-thumb." The idea that the required equipment capacity equals the floor area divided by some magic number is absurd. Heat loss and heat gain depends on individual circumstances. Floor area to tonnage ratios for the U.S. housing stock can



## WITH OUR NEW LINE OF HEAT PUMPS!

The first phase of FEDDERS "Change Your Fortune" Program of feature-packed products at everyday low prices was the introduction of a full line of 10 and 12 SEER cooling condensing units made at our world-class, cost-efficient factories in China. These units are creating many converts across the country.

The second phase presented Indoor Air Quality (IAQ) Trion® air cleaners and Humidifier® humidifiers that will enable you to make a fortune with price reductions of up to 33% off our already competitive prices.

Now in phase three, we are introducing everyday low prices on a full line of 10 and 12 SEER heat pump condensing units and matching air handlers.

How does FEDDERS give you these everyday low prices? Our world-class, cost-efficient China factories — eight (8) of them — and our unbeatable global sourcing.

FEDDERS keeps it simple too. No complicated programs, just more quality products at everyday low prices. More products, more ways FEDDERS helps you make your fortune.

Call us at 1-800-225-6753 and seize this opportunity to change your fortune.

**FEDDERS**  
UNITARY PRODUCTS

P.O. 7938 • Longview, TX 75607 • 800-225-6753 • www.fedders.com



