



Department of Administrative Services

Purchasing and Contracts

500 S Grand Central Pky 4th Fl • Box 551217 • Las Vegas NV 89155-1217
(702) 455-2897 • Fax (702) 386-4914

Sabra Smith Newby, Chief Administrative Officer
Adleen B. Stidhum, Purchasing Manager



CLARK COUNTY, NEVADA BID NO. 603836-15 CAMP LEE CANYON COOLER REFURBISHMENT

October 6, 2015

ADDENDUM NO. 2

INVITATION TO BID

1. The bid opening date of October 22, 2015 at 2:15:00 p.m. **has been changed to October 13, 2015 at 2:15:00 p.m.**

DRAWINGS

2. SK-1: (See Attachment) – Sheet S1.0, Modify Floor plan 1 “Improved Site Plan” to show changed internal elevations.
3. SK-2: (See Attachment) - Sheet S2.0, Delete Section A, and Replace it with sketch SK-2.

QUESTIONS AND ANSWERS

4. QUESTION: “The new floor needs to be poured level for proper installation of the new cooler box / panels. Trying to find a manufacturer that will custom build panels to accommodate a pitched floor will result in excessive lead times. Please confirm that this change can be made.”

ANSWER: Pour concrete floor flat inside cooler and freezer per SK-1 and SK-2 as reflected on Item 4 above. Simplify Walk-In cooler/freezer to fasten to flat concrete floor. Fasten to floor and seal against Walk-In walls per manuf. recommendations. Seal concrete floor as originally specified.

5. QUESTION: “The drawings show (1) 3” PVC sleeve for the refrigeration line sets. We will need either (1) 4” PVC sleeve or (2) 3” PVC sleeves. Please confirm which will be acceptable.”

ANSWER: Use a total of (2) 3” PVC sleeves. Original intent was to have one 3” PVC sleeve for each set of lines.

BOARD OF COUNTY COMMISSIONERS

STEVE SISOLAK, Chairman • LARRY BROWN, Vice Chairman
SUSAN BRAGER • CHRIS GIUNCHIGLIANI • MARILYN KIRKPATRICK • MARY BETH SCOW • LAWRENCE WEEKLY
DONALD G. BURNETTE, County Manager

6. **QUESTION:** "All the box manufacturers are quoting boxes with a built in freezer floor. Looks like that would be the quickest/cheapest way to go. A floor in the freezer with a ramp to go down to the concrete floor in the cooler. Otherwise I'm being told will need a glycol heating system installed in the concrete, and that sounds like more hassle and maintenance expense we don't need. Is a built-in freezer floor a change we could make to this bid?"

ANSWER: NO - Walk-in Freezer floor is not required. Bid drawing S.2.0, Section Detail C, shows 1 inch foam board underneath the new slab. Seal concrete floor as originally specified. Sealed Concrete is acceptable by Southern Nevada Health District (SNHD). A glycol heating system installed in the concrete floor is not required.

Except as modified herein all other bid specifications, terms and conditions and special conditions shall remain the same.


ISSUED BY:



SANDY MOODY-UPTON
Purchasing Analyst II

Attachments: SK-1 - Improved Site plan
SK-2 – Section at Cooler/Freezer

Cc: Chuck James, Real Property Management
Brian Connolly, Real Property Management
Chat Patel, Real Property Management
Adriana Gonorazky, Adriana@innovanv.com

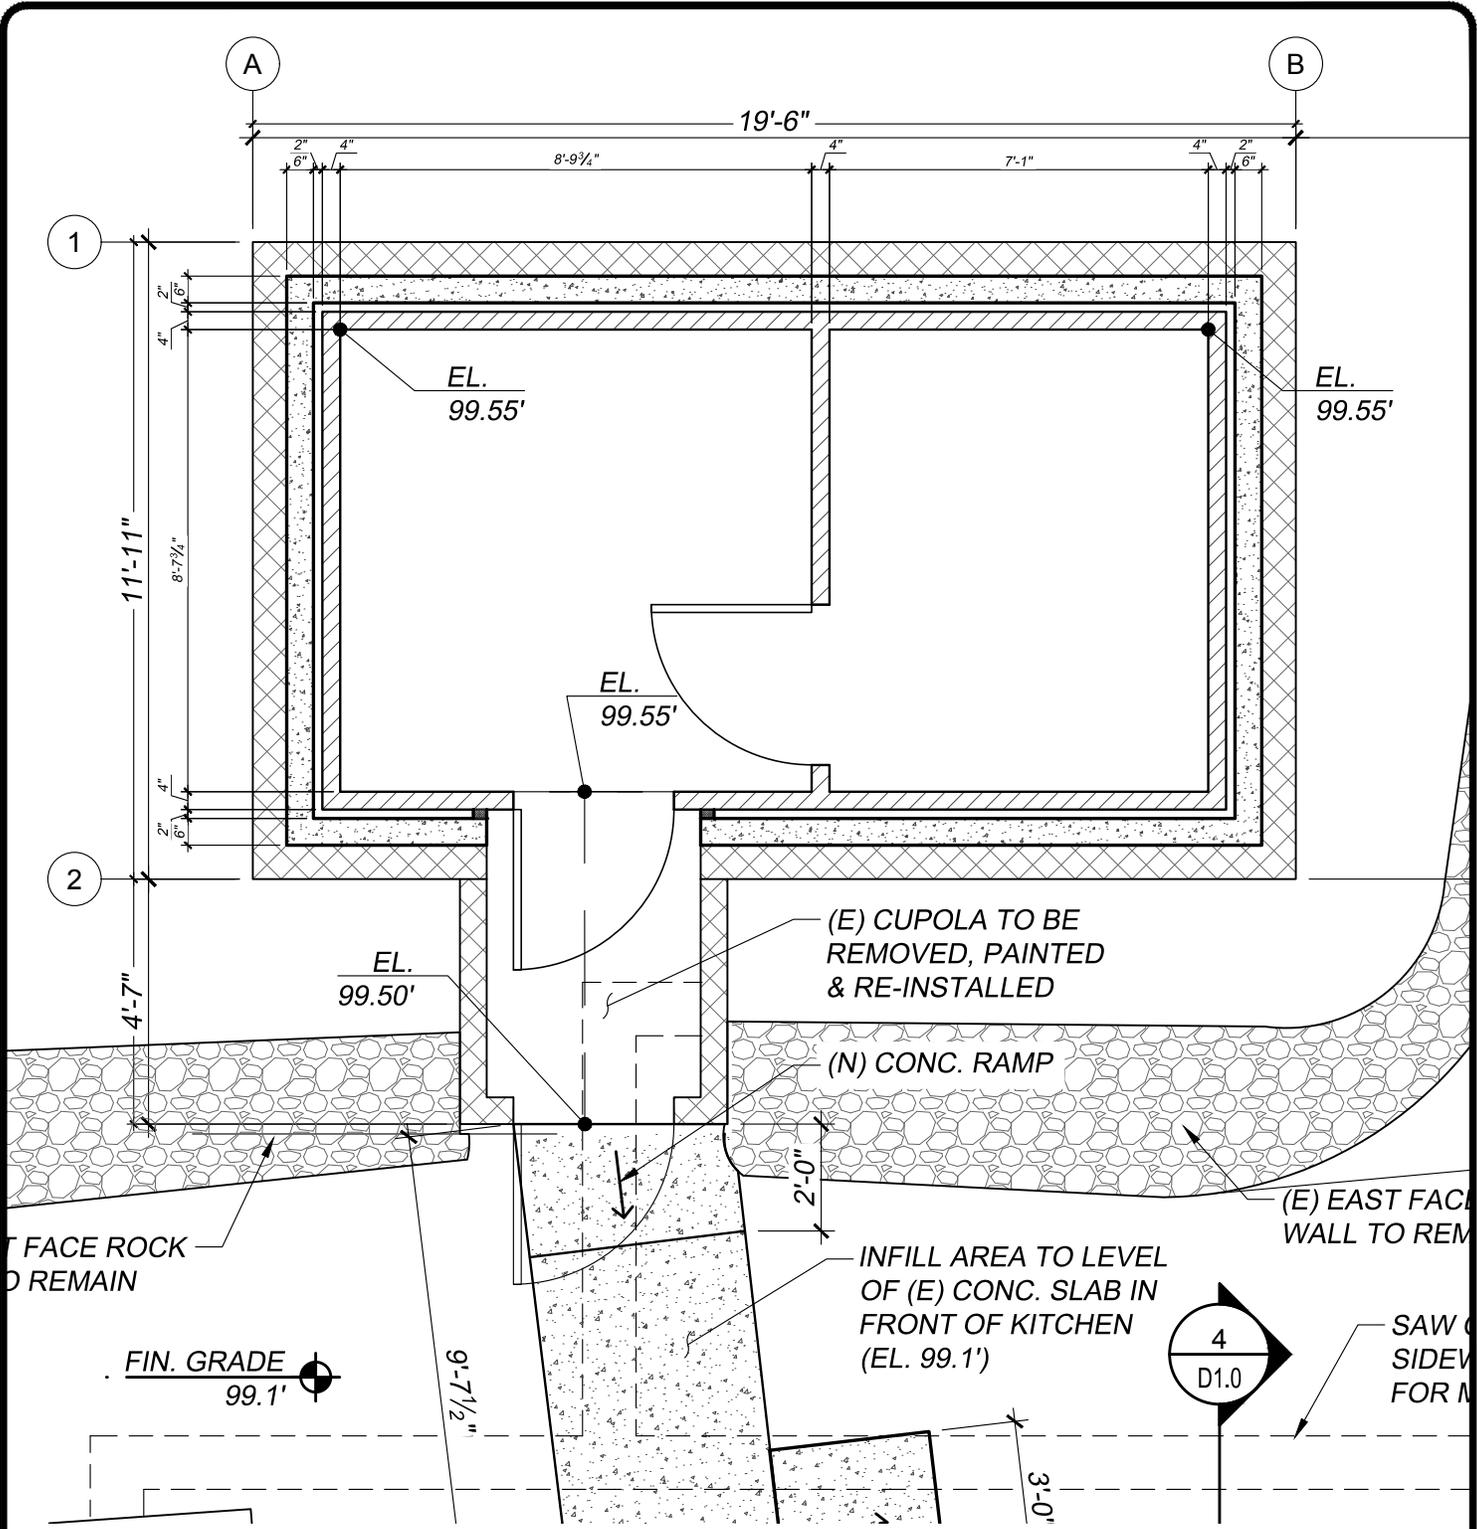


1 IMPROVED PARTIAL SITE PLAN
 SCALE: N.T.S. REF. S1.0 FOR INFO. NOT SHOWN

INNOVA TECHNOLOGIES
 INNOVATING SOLUTIONS FOR YOU
 TRANSPORTATION ENGINEERING SOLUTIONS
 STRUCTURAL ENGINEERING
 CONSTRUCTION ENGINEERING
 1432 S. JONES BLVD.
 LAS VEGAS, NV 89146
 TEL: 702.220.6640
 FAX: 702.220.7740
 WWW.INNOVANV.COM

ADDENDUM No. 2
CAMP LEE CANYON COOLER REFURBISHMENT

Proj. No.:	115-065
Design:	SEM
Drawn:	RAB
Checked:	AGB
Issue Date:	10-06-15
Sheet	SK-1

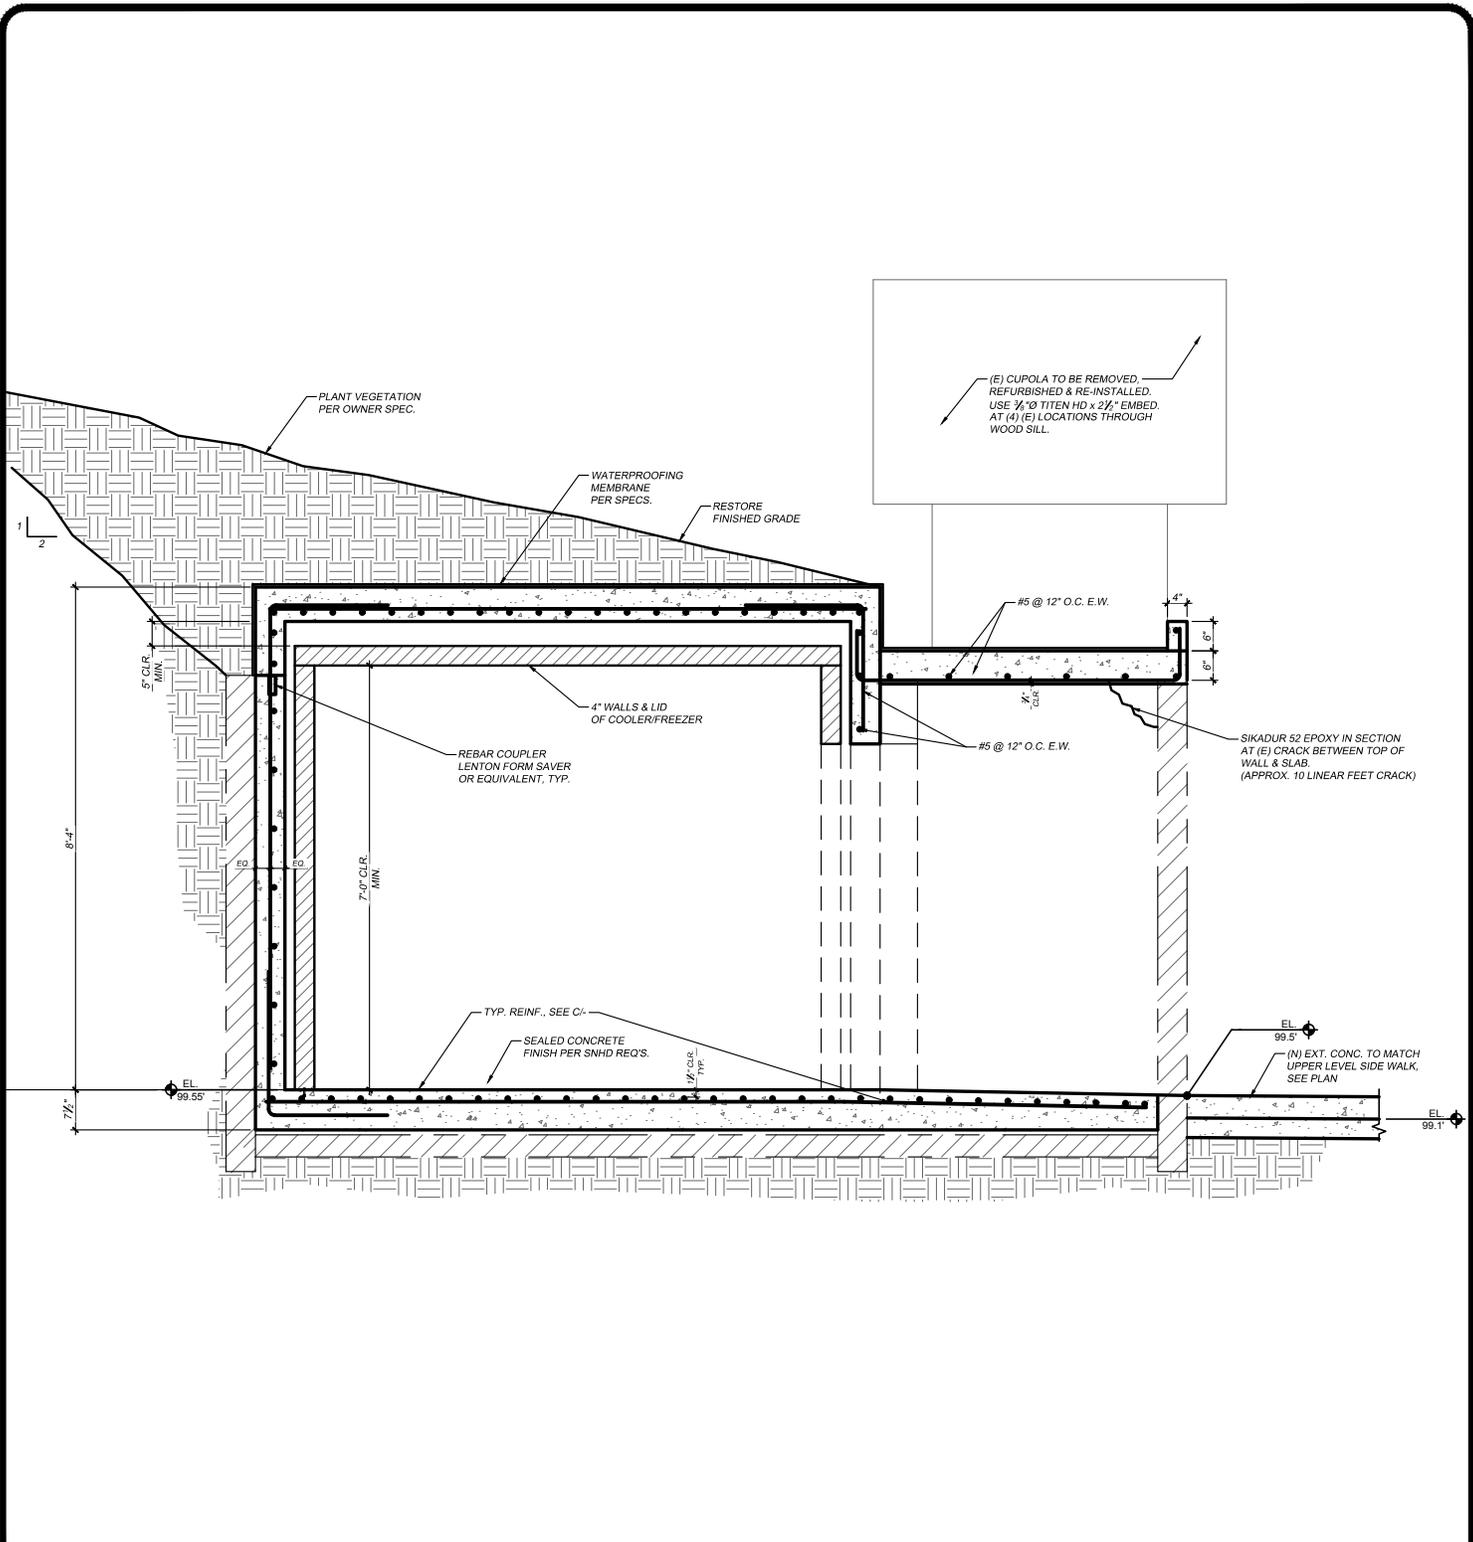

A SECTION
SCALE: N.T.S.

REF. A/S2.0

INNOVA
TECHNOLOGIES
TRANSPORTATION ENGINEERING SOLUTIONS
STRUCTURAL ENGINEERING
CONSTRUCTION ENGINEERING

INNOVATING SOLUTIONS
FOR YOU ®
1432 S. JONES BLVD.
LAS VEGAS, NV
89146
TEL: 702.220.6640
FAX: 702.220.7740
WWW.INNOVANV.COM

ADDENDUM No. 2

CAMP LEE CANYON COOLER
REFURBISHMENT

Proj. No.:	115-065
Design:	SEM
Drawn:	RAB
Checked:	AGB
Issue Date:	10-06-15
Sheet	SK-2