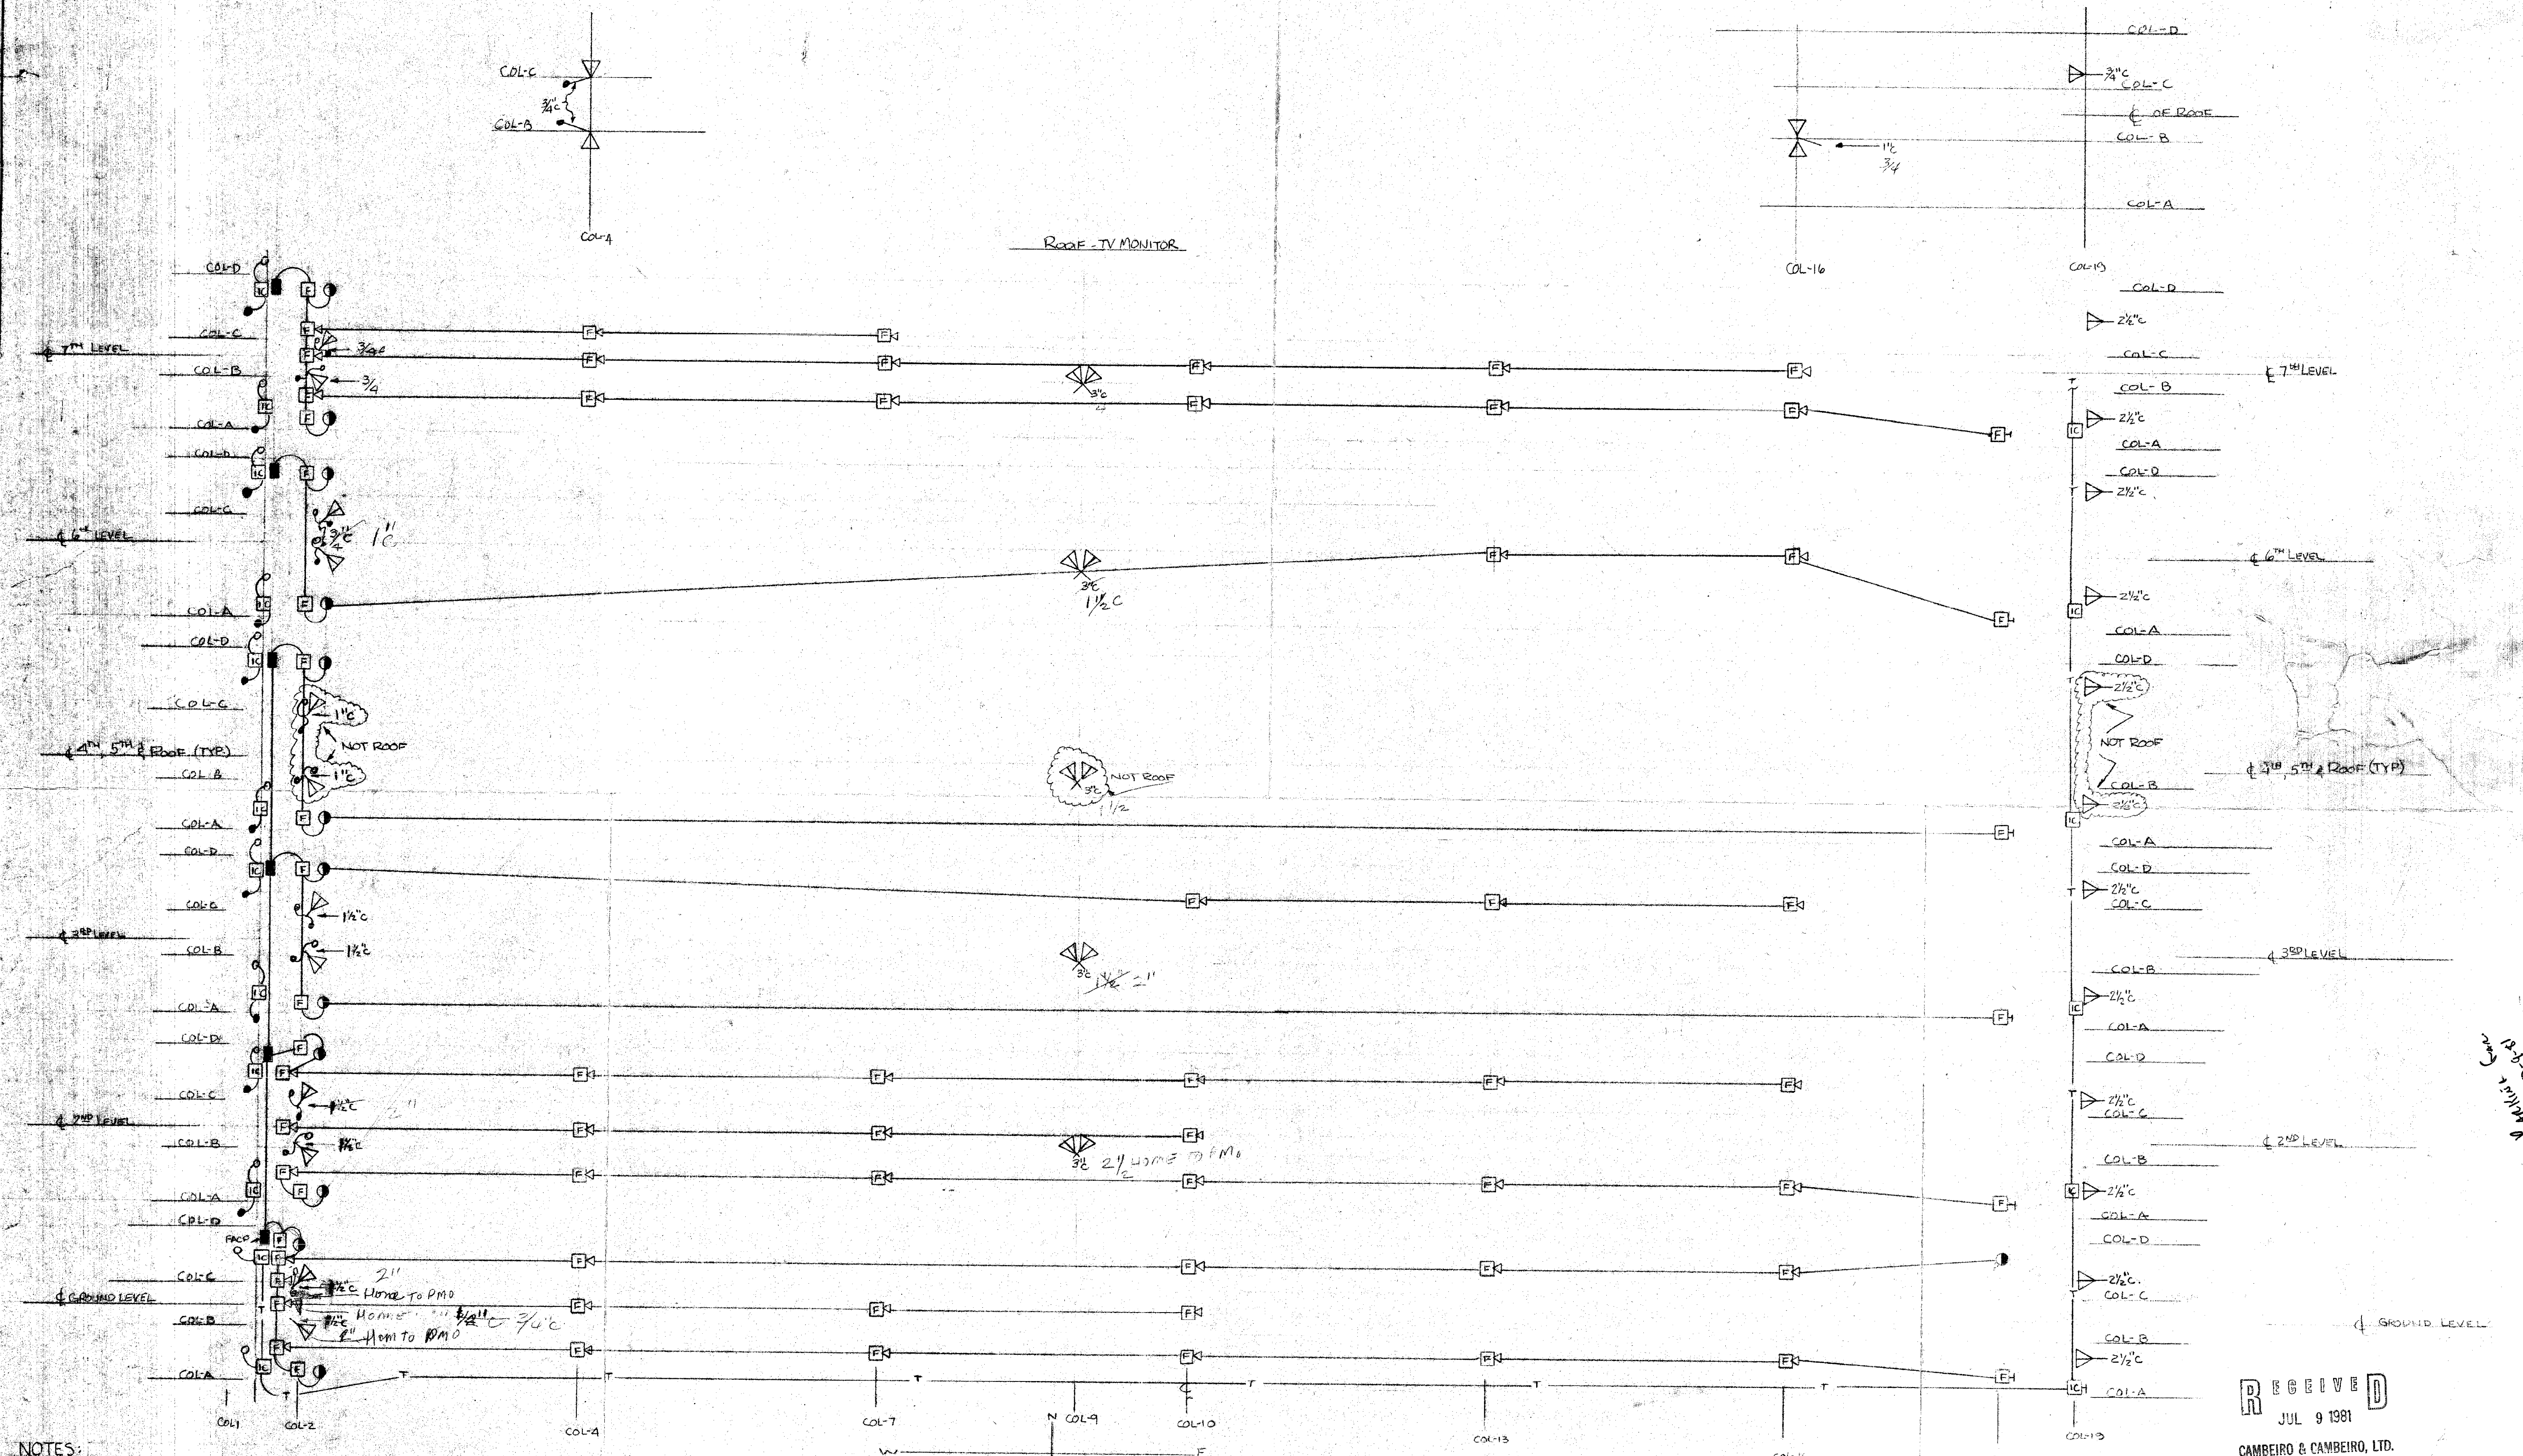

NOTES:

1- ALL WIRE WILL BE SOLID CONDUCTOR U.L APPROVED FIRE ALARM WIRE SIZED ACCORDINGLY TO F.A. MANUFACTURES SPECIFICATIONS
2- EQUIPMENT IS NOTIFIER 4812 ALARM SYS. WITH SAS 100 COMMUNICATION PACKAGE
3- SYSTEM WILL BE CLASS "A"
4- SYSTEM WILL COMPLY WITH UBC & CITY ORDINANCES

Approved 6-5-81
Las Vegas Fire Dept
Ray Peeple

SYMBOLS

- ▪ (CONNECTION TO) FIRE ALARM CONTROL PANEL
- F◁ FIRE ALARM HORN
- IC INTERNAL COMMUNICATIONS SMOKE PHONE
- ◑ MANUAL PULL ALARM
- ◁ T.V. SURVEILLANCE

RECEIVED
JUL 9 1981
CAMBEIRO & CAMBEIRO, LTD.

BUILDING

1609

24 X 36 PRINTED ON NO. 1000H CLEARPRINT

1609